



Balancing power and variable renewables: Three links[☆]



Lion Hirth^{a,b,c,*}, Inka Ziegenhagen^d

^a Neon Neue Energieökonomik GmbH (neon), Berlin, Germany

^b Mercator Research Institute on Global Commons and Climate Change (MCC), Berlin, Germany

^c Potsdam Institute for Climate Impact Research (PIK), Potsdam, Germany

^d Prognos AG, Berlin, Germany

ARTICLE INFO

Article history:

Received 28 April 2014

Received in revised form

24 April 2015

Accepted 30 April 2015

Available online 4 June 2015

Keywords:

Balancing power

Control power

Regulating power

Variable renewables

Wind power

Solar power

Market design

ABSTRACT

Balancing power is used to quickly restore the supply-demand balance in power systems. The need for this tends to be increased by the use of variable renewable energy sources (VRE) such as wind and solar power. This paper reviews three channels through which VRE and balancing systems interact: the impact of VRE forecast errors on balancing reserve requirements; the supply of balancing services by VRE generators; and the incentives to improve forecasting provided by imbalance charges. The paper reviews the literature, provides stylized facts from German market data, and suggests policy options. Surprisingly, while German wind and solar capacity has tripled since 2008, balancing reserves have been reduced by 15%, and costs by 50%.

© 2015 Elsevier Ltd. All rights reserved.

Contents

1. Introduction	1036
2. Fundamentals of balancing systems	1036
2.1. Balancing what?	1037
2.2. Roles and responsibilities	1038
2.3. Types of balancing power	1038
2.4. TSO cooperation	1038
3. Balancing reserve requirement: The impact of VRE	1039
3.1. Reserve sizing methodologies	1039
3.2. Sources of imbalances	1039
3.3. Probabilistic reserve sizing in Germany	1040
3.4. Modeling the impact of VRE on reserve requirements	1040
3.5. The German experience: A paradox?	1041
3.6. Policy options: Advancing reserve calculations	1042
4. Balancing power market: Enabling VRE participation	1042
4.1. Balancing power market design	1042

[☆]We would like to thank Catrin Jung-Draschil, Swen Löppen, Bart Stoffer, Mats Nilsson, Thorbjorn Vest Andersen, Philipp Hanemann, Susann Wöhlte, Bastian Rühle, Eckart Boege, Dania Röpke, Viktoria Neimane, Maryam Hagh Panah, Kathrin Goldammer, Benjamin Bayer, Dominik Schäuble, Hannes Peinl, Rolf Englund, Oliver Tietjen, Set Persson, Felix Buchholz, Christian Andersson, Michael Pahle, Brigitte Knopf, Fabian Joas, Falko Ueckerdt, Eva Schmid, Fredrik Carlsson, Matthias Klapper, Kristian Gustafsson, Ralf Kirsch, Sundar Venkataraman, Mike O'Connor, Aidan Tuohy, Alexander Zerrahn, Eckehard Schulze, and the anonymous referees for inspiring discussions and valuable comments. Maximilian Schumacher and Julian Bauer provided helpful research assistance. The usual disclaimer applies. The paper has been presented at the YEEES, Strommarkttreffen, Enerday, Euroforum, and EEM conferences. Parts of earlier versions of this article have been published as conference proceedings and in Hirth and Ziegenhagen [59,60].

* Correspondence to: Neon Neue Energieökonomik GmbH, Karl-Marx-Platz 12, 12043 Berlin, Germany. Tel.: +49 1575 5199715.

E-mail address: hirth@neon-energie.de (L. Hirth).

URL: <http://www.neon-energie.de> (L. Hirth).

4.2.	Market size and market development in Germany	1042
4.3.	Providing balancing power with VRE generators.....	1044
4.4.	The opportunity costs of reserve provision: Why VRE should participate	1045
4.5.	Policy options: Lowering entrance barriers	1045
5.	Imbalance settlement system: Setting the right incentives.....	1046
5.1.	Imbalance settlement regimes	1046
5.2.	Estimates of VRE balancing costs	1046
5.3.	German imbalance prices	1046
5.4.	The balancing price: an incentive for better forecasting	1047
5.5.	Passive and active balancing.....	1048
5.6.	Policy options: The imbalance charge as price signal	1048
6.	Concluding remarks.....	1048
	References.....	1049

1. Introduction

Electricity generation from variable renewable electricity sources (VRE), such as wind and solar power, has grown rapidly during recent years and is expected to continue to grow. The fact that these generators are distributed, non-synchronous, and weather-dependent causes specific challenges when integrating them into power systems [54,68,71]. With increasing amounts of VRE in many countries, system integration has become a major public policy debate with a particular emphasis on the stress that forecast errors put on balancing systems.

Balancing power is used to stabilize the active power balance of integrated power systems on short time scales from seconds to hours. In AC power systems, the demand–supply balance has to hold at every instant of time to ensure frequency stability at, usually, 50 Hz or 60 Hz. Frequency deviations have a number of problematic consequences, one being that they can mechanically destroy rotating machines such as generators. Technical procedures and economic institutions have evolved to prevent frequency instability, and the most important of these is “balancing power”¹.

Electricity generation from VRE has been growing rapidly in many countries, driven by technological progress, economies of scale, and deployment subsidies. Global solar PV capacity has reached 140 GW, a fourteen-fold increase since 2007, and there has been a four-fold increase in wind power to 320 GW [100]. Several power systems now accommodate VRE shares of 15% to 40%, including Eastern Inner Mongolia, Denmark, Spain, Portugal, Ireland, Lithuania, and Germany. The IEA [72] projects that medium-term growth will continue and long-term models forecast that VRE shares by 2050 will need to be several times higher than today [47,84,81]. Hence, system integration will remain challenging.

This review paper explores the interaction of wind and solar with balancing power. We identify and discuss three major links between VRE and balancing systems (Fig. 1). Each link has been previously discussed in the literature, but to the best of our knowledge this is the first attempt to comprehensively account for the interactions between VRE and balancing power.

First, and most obviously, VRE generators, being weather-dependent and hence inherently stochastic, are subject to forecast errors which

increase the need for holding and deploying balancing reserves. Second, however, VRE generators can also supply balancing services, although this requires policies and markets to be appropriately designed; balancing services supplied by VRE generators obviously reduce the pressure on the balancing system. Finally, the imbalance price which is the financial penalty for forecast errors, determines the size of forecast errors given its influence on the behavior of VRE generators. If set correctly, the imbalance price can stimulate more accurate forecasting and incentivize VRE generators to improve system stability. The three links are not independent, and policy that is only targeted at one of the channels is likely to be suboptimal. We hope our holistic view generates a more comprehensive understanding of the balancing challenge and explores the entire solution space for policy makers, market participants, and system operators.

The aim of this paper is to stimulate and structure the discussion on the interaction between VRE and balancing power. It particularly targets practitioners such as policy makers, regulators, system operators, market participants, and VRE investors. It aims to provide an overview of topics, a guide through the literature, and a summary of policy proposals. We complement the literature review with model results and empirical data where appropriate. We study German markets and policies in detail, but most observations and recommendations also apply to other European markets, and, albeit to a lesser degree, to U.S. power systems. Germany is an interesting case not only because of the extent and rapid growth of VRE penetration, but also because of data availability, cooperation between system operators, and market design reforms.

We believe that three broad conclusions can be drawn from this review. First, we find the impact of VRE on the balancing system to be less dramatic than sometimes believed. VRE growth has had moderate impact on volumes and costs of balancing power at best; in many circumstances other factors had a larger impact. Second, the design of balancing power markets constitutes an unnecessary entry barrier to this market, and prices in balancing and imbalance markets do not regularly reflect marginal costs. With appropriate market design, VRE wind and solar not only consume but can also provide balancing services. Finally, VRE and balancing systems interact via various channels. Policies interact with each other and should be considered in context. Usually, multiple policies exist to achieve the same objective, a fact that might ease implementation challenges.

The paper is organized as follows. Section 2 gives an overview of balancing systems. Sections 3–5 review the three links: reserve requirements, balancing power markets, and imbalance settlement. Section 6 concludes.

2. Fundamentals of balancing systems

We define the balancing system (or “balancing regime”) as the set of technical and economic institutions that are used to maintain

¹ There are a multitude of names for “balancing power”. Inconsistent and diverging nomenclature is a major problem in this field. Here we use the most internationally common generic term “balancing power”. European transmission system operators have used the term “control power” [115], but are replacing it by “operational reserves” [37]. In Germany and Nordic countries, “regulating power” is more commonly used. Other names are “balancing reserve”, “frequency control”, and “reserve power”. Certain types of balancing power are sometimes used broadly, such as “regulation”, “load following”, “contingency reserves”, “frequency containment reserve”, “frequency restoration reserve”, or “replacement reserve”. Inertia, or “inertial response”, which is an active power response similar to balancing power, driven by the electromechanical properties of synchronous machines, takes place at even shorter time scales and is not discussed in this paper (see [33]).

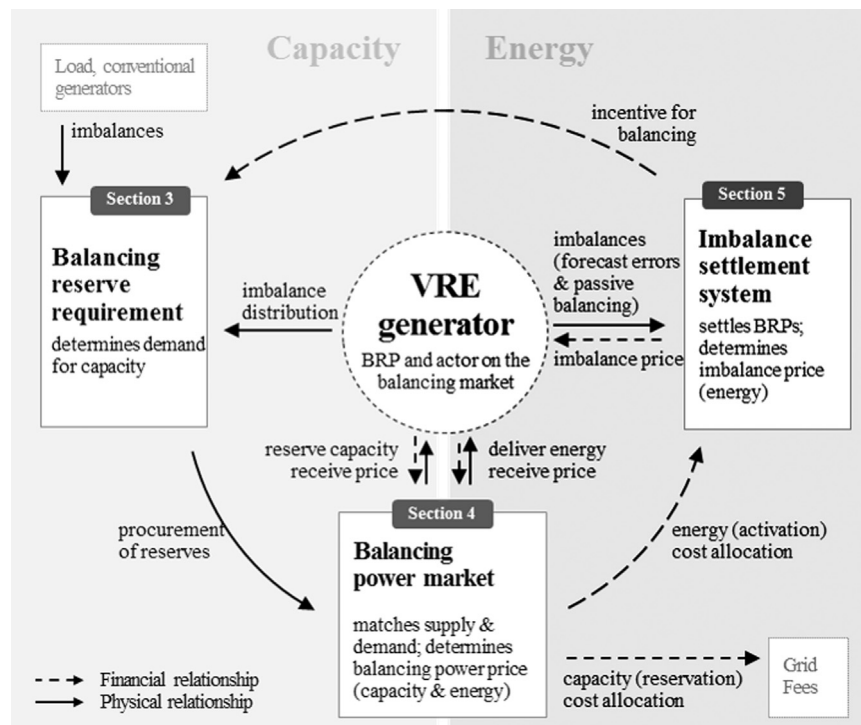


Fig. 1. The three links between VRE and the balancing system. Each link will be discussed in one section of this paper.

and restore the short-term active power balance in integrated electricity systems. Other system (ancillary) services, such as reactive power compensation (voltage support) or transmission congestion management (re-dispatch), are not within the scope of this article². The balancing system comprises two economic mechanisms: the “balancing power market” to acquire balancing power, and the “imbalance settlement system” to financially clear the imbalances.

This section outlines some principles of balancing systems. We clarify the roles of different actors and present an overview of the types of balancing power used in continental Europe (UCTE)³. Rebours et al. [101,102], TenneT [112], ENTSO-E [36], Ela et al. [31], and Cognet and Wilkinson [20] provide international comparisons. Vandezande et al. [116] discuss economic aspects of market design. Kristiansen [83] and Bang et al. [5] provide a comprehensive survey of the Nordic balancing system while Ela et al. [31,32] and NERC [95] do the same for American systems. Consentec [25] provides, in German, a descriptive overview of the German balancing system.

This article focuses on electricity. Natural gas markets feature a similar system of balancing energy to which many of the general arguments apply [78,2].

2.1. Balancing what?

Two geographic entities are involved in balancing: the synchronous system (interconnection) and balancing areas (control areas) within the synchronous system (Fig. 2). The synchronous system is a geographic area usually equivalent to several countries, and is characterized by a common steady-state frequency. The continental United States features three synchronous systems (Eastern and

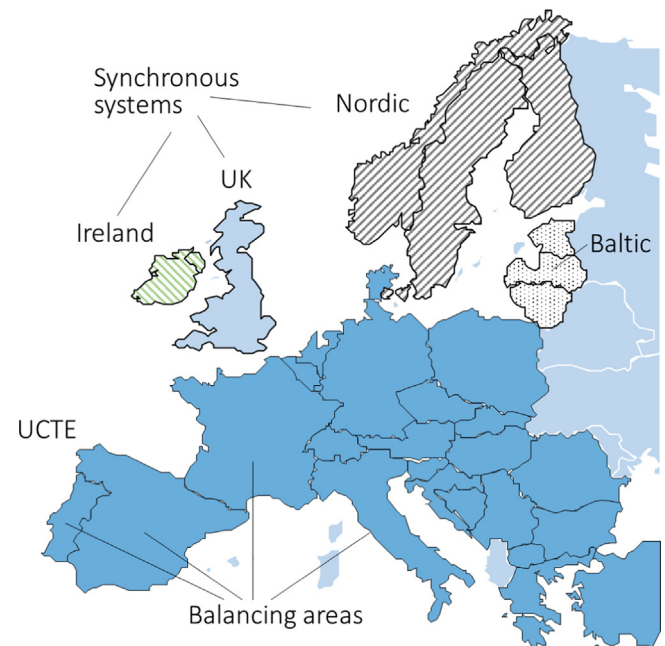


Fig. 2. Each synchronous system consists of one or several balancing areas. Balancing power is used to balance both the synchronous area (frequency at 50 Hz) and the balancing area (area control error at zero). UCTE (or “Regional Group Continental Europe”) is the largest European synchronous system that covers all of Europe except Ireland, the UK, the Baltic and Nordic region, Albania, the countries east of Poland/Romania, and most islands. It is composed of about 25 balancing areas. Germany is divided into four balancing areas, which in practice are operated as one (see Section 3.5).

Western Interconnect, ERCOT), while Europe features five synchronous systems, of which the UCTE is by far the largest.

Balancing areas are regions, usually of the size of countries, for which one system operator is responsible. Balancing systems are meant to balance *both* the synchronous system and each balancing area. In the language of control theory, two variables with two set

² Some European countries use balancing energy for re-dispatch, or use integrated balancing power/re-dispatch mechanisms. Germany and most of its neighbors do not ([41], p. 148).

³ As an organization, the UCTE (Union for the Co-ordination of Transmission of Electricity) has been replaced by the “ENTSO-E Regional Group Continental Europe”. We refer to UCTE with the former name for convenience.

Table 1

A control theory perspective on the balancing system.

	Synchronous system	Balancing area
Geographic scope	Entire system (continental Europe)	Several sub-systems (countries)
Target variable	Frequency	Area control error (ACE)
Set point	50 Hz	Zero
Rationale	Avoid damages caused by frequency deviation	Avoid interconnector overload; “polluter pays” principle

points are targeted by the balancing system: frequency, and the imbalance of each balancing area. The synchronous system is balanced if frequency is at its nominal value (50 Hz). The balancing area is balanced if net import balance is at its scheduled value (the area control error is zero).

2.2. Roles and responsibilities

In Europe, four types of actors interact in balancing systems: balance responsible parties, transmission system operators, suppliers of balancing power, and regulators.

Balance responsible parties (BRPs) or “program responsible parties” are market entities that have the responsibility of balancing a portfolio of generators and/or loads. BRPs can be utilities, sales companies, and industrial consumers. Each physical connection point is associated with one BRP. BRPs deliver binding schedules to system operators for each quarter-hour of the next day⁴, and are financially accountable for deviations from these schedules.

Transmission system operators (TSOs) operate the transmission network and are responsible to balance injections and off-takes in their balancing area. TSOs activate balancing power to physically balance demand and supply if the sum of BRP imbalances is non-zero. Specifically, TSOs have four obligations:

1. determine the amount of capacity that needs to be reserved as balancing power *ex ante*
2. acquire that capacity; determine its price (capacity and/or energy) *ex ante*
3. activate balancing power; determine the imbalance price (energy) in real time
4. financially clear the system and allocate costs (via imbalance price and/or grid fees) *ex post*.

Suppliers of balancing power supply reserve capacity, and deliver energy if dispatched by the TSO. They are obliged to deliver energy under pre-specified terms, for example within a certain time frame, with certain ramp rates, and for a specific duration. Suppliers are traditionally generators, but can also be consumers. Typically, suppliers of balancing power receive a capacity payment (€/MW·h)⁵ because capacity reservation incurs opportunity costs, and/or energy payment (€/MWh) since activation is costly.

Regulators determine the balancing power market design. They also monitor market power and prescribe the pricing formula of the imbalance price. Unlike most in other markets, the rules that govern trade of balancing power are set by authorities and have not emerged bottom-up from market interaction.

⁴ Schedules are usually submitted one day in advance, but can be adjusted until about one hour ahead of delivery. In some markets, schedules can be adjusted after delivery by swapping volumes between BRPs in so-called ‘day after’ markets, see Section 5. Some markets, such as in France, feature half-hourly schedules.

⁵ This is the price of reserving capacity per MW and per hour, which is not the same as the price for delivering one MWh of electrical energy. Power prices are reported in different units, including €/MW per day, €/MW per week, €/MW per month, €/kW per year, and €/MW per year. We report all capacity prices as €/MW per hour (€/MW·h). Note that despite having the same unit, these capacity prices are not energy prices, which we denote as €/MWh (without the dot).

2.3. Types of balancing power

Characteristics, classification, and nomenclature of balancing power vary across power systems. Since multiple sources of imbalances exist with different characteristics (see Section 3.2), several types of balancing power, or balancing power products, are employed simultaneously in most power systems. Balancing power types can be distinguished along several dimensions:

- purpose (operating/non-event v. contingency/event reserve)
- state of supplying power plant (spinning v. stand-by reserve)
- target system (synchronous system v. balancing area)
- response time (fast v. slow)
- activation frequency (direct/continuously v. scheduled)
- way of activation (manual v. automatic)
- positive, negative, or both (upward v. downward v. symmetric)

In the UCTE, balancing power is called “control power” [115], and three different types are used: primary control, secondary control, and tertiary control. They differ in purpose, response time, and the way they are activated (Table 2).

Primary control power (PC) can be fully deployed within 30 s. Being a shared resource within the UCTE, it is not activated by TSOs but by locally measured frequency deviation. At the power plant level, activation is implemented as turbine-governor control. PC is activated proportionally to the frequency deviation from 50 Hz up to full activation at deviations of 200 mHz. It is calibrated such that imbalances are replaced and frequency drops are contained (but not restored). Small deviations below 10 Hz do not lead to activation (dead band). PC can be classified as a fast, automatic, symmetric spinning reserve that is used to balance the synchronous system. It is sized as a contingency reserve (0), but also used for operational imbalances.

Secondary control power (SC) has to be available within 5 min after activation. It is activated automatically and centrally by TSOs via an automatic generation control (AGC) signal that is updated every few seconds. SC is used to restore nominal frequency, and to re-balance the respective balancing area, such that at steady-state, imbalances are replaced by SC from the same balancing area. SC can be supplied by some stand-by hydro plants, but is mostly provided by synchronized thermal generators. Hence, it is an automatic reserve with direct activation that balances both the synchronous system and the balancing area up and down; to a large extent, it is a spinning reserve.

Tertiary control power (TC), or minute reserve, is used to replace SC over time. It is either directly activated or supplied in schedules of 15 min. Activation is a decision taken by TSO staff based on current and expected deployment of SC. TC is mostly supplied by stand-by generators. UCTE [115] and Rebours et al. [101] provide more technical details on the three types of balancing power.

2.4. TSO cooperation

To integrate European power markets, the European Union aims to harmonize and integrate European balancing systems and markets. If implemented as planned, the European balancing system and all of its markets will significantly change in the coming years.

Table 2
Types of balancing power in the UCTE.

	Primary control	Secondary control	Tertiary control (minute reserve)
Response time	30 s, direct (continuous)	15 min or less, direct	15 min, direct or scheduled
System	UCTE	UCTE and balancing area	UCTE and balancing area
Target variable	Frequency	ACE and frequency	Current and expected level of SC activation
Activation	Based on local frequency measurement	Centralized (TSO); IT signal (AGC)	Centralized (TSO); phone/IT signal
Suppliers (typical)	Synchronized generators, (large consumers)	Synchronized generators, stand-by hydro plants, large consumers	Synchronized and fast-starting stand-by generators, large consumers
Reserved capacity	3000 MW in UCTE (600 MW in Germany)	Determined by TSO (2000 MW in Germany)	Determined by TSO (2500 MW in Germany)

Depending on country ([41], p. 146). German TSOs require a response time of 15 min.

Important actors in this process are EU institutions (commission and council), energy regulators (Agency for the Cooperation of Energy Regulators ACER) and TSOs (European Network of Transmission System Operators for Electricity ENTSO-E). On 15 topics, ACER has published “Framework Guidelines” based on which ENTSO-E drafts “Network Codes”. These codes then enter the EU Comitology process after which they become legally binding⁶.

Two of the 15 topics relate to balancing power, “Balancing Energy” and “Load-frequency Control and Reserves”. Framework Guidelines were finalized in 2012 [3,4] and Network Codes finalized by 2014 ([38,39]. Mott MacDonald and SWECO [90] provide an impact assessment of the Balancing Energy Framework Guideline. One ACER official has called the Balancing Energy network code “the most complex of all”⁷.

The network codes introduce “frequency containment reserve” and “frequency restoration reserve” as common terminology for all European synchronous systems, which will replace PC, SC, and TC, and the reserve types used in the other synchronous areas of the European Union. The codes will also affect the way reserves are procured (Section 4).

In parallel to the top-down Network Codes process, several bottom-up regional TSO cooperation initiatives have emerged during recent years [40]. Some initiatives focus on SC, the best-known of which is the “International Grid Control Cooperation” (IGCC) of central European TSOs. They are often considered to take place in four stages, with increasing degree of cooperation: (i) imbalance netting, (ii) common reserve dispatch, (iii) common reserve procurement, (iv) common reserve sizing. Most initiatives, include the IGCC, are currently restricted to (i), which means they avoid opposed SC activation. Even at this stage, cost savings can be substantial [118,42,110]. Other TSO initiatives focus on the common procurement of PR, such as bilateral cooperation of the Swiss TSO with French, German, and Austrian TSOs. Steps (iii) and (iv) require the reservation of interconnector capacity, which comes at a cost. Gebrekiros et al. [49] provide model-based evidence to show that benefits can outweigh costs.

Full international integration requires harmonizing procurement, products, and pricing. This seems to be out of reach for several years. But even so, partial market integration and bottom-up TSO cooperation are shaping balancing markets today.

3. Balancing reserve requirement: The impact of VRE

This section discusses the impact of VRE on balancing reserve requirements. We give an overview of reserve sizing methods and explain which variables cause system imbalances. We then discuss

the impact of VRE forecast errors on the balancing reserve, and present new model results. Although studies disagree about the size of the impact, all models show that more VRE capacity tends to increase balancing requirements. Empirically, however, the German case seems to prove theory wrong: balancing reserves could be reduced while VRE capacity increased. Finally, we suggest a number of policy options.

3.1. Reserve sizing methodologies

TSOs need to determine the balancing reserve *ex ante*. The methodologies they use vary across types of balancing power and between TSOs. Holttinen et al. [69] provide an overview of methodologies. These can be distinguished by two dimensions: probabilistic v. deterministic, and static v. dynamic.

The idea behind deterministic approaches is to size the reserve according to a specific event, such as the largest credible contingency ($N-1$ criterion). These approaches, however, do not account for less severe events, their probability, or correlation between sources of imbalances. The idea of probabilistic (stochastic, statistic) methods is to size the reserve such that a certain, pre-defined level of system reliability is met. These methods estimate the probability density function of system imbalances and use the reliability target as a cut-off to determine the size of the reserve. Probabilistic approaches require detailed knowledge of sources of imbalances, their probability distribution, and their correlation.

Reserves can be determined for long time periods such as one year (static sizing) or more frequent periods depending on the current or expected status of the system (dynamic sizing). Deterministic sizing is usually static; probabilistic sizing can be static or dynamic.

In continental Europe, reserve requirements are codified in UCTE [115]. For PC, UCTE prescribes a common European deterministic-static approach: 3000 MW are reserved, in order to compensate the loss of two large nuclear reactors connected to the same bus bar. For SC and TC, UCTE suggests a number of different approaches, but leaves the decision to the TSOs. As a consequence, the level of SC+TC reserves vary widely—from 5% of average load in France to 14% in Belgium [20]. German TSOs use a static-probabilistic approach, which we will discuss in the following.

3.2. Sources of imbalances

System imbalances can stem from different sources. One way to categorize them is to distinguish stochastic from deterministic processes (Table 3)⁸. Stochastic processes are unplanned outages and forecast errors. Deterministic processes are the deviations between the stepwise (discrete) schedules and continuous

⁶ For an overview of the process, see also the ACER website www.acer.europa.eu/Electricity/FG_and_network_codes/ENTSO-E website www.entsoe.eu/major-projects/network-code-development/electricity-balancing/.

⁷ Tahir Kapetanovic, IEWT conference, Vienna, 2015.

⁸ This has nothing to do with stochastic/deterministic estimation methodologies for reserve sizing.

Table 3
Variables that cause system imbalances.

	Stochastic	Deterministic
Thermal and hydro generation	Unplanned plant outages	Schedule leaps
VRE generation	Forecast errors	
Interconnectors	Unplanned line outages	
Load	Forecast errors	

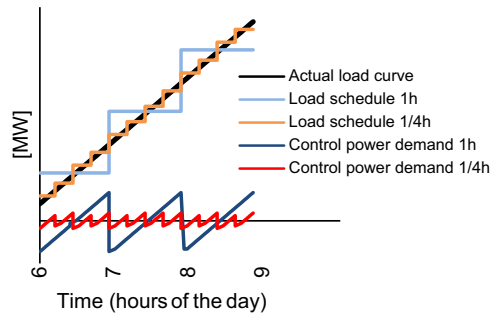


Fig. 3. Discrete schedules cause imbalances (illustration). Quarter-hourly schedules cause smaller imbalances than hourly schedules.

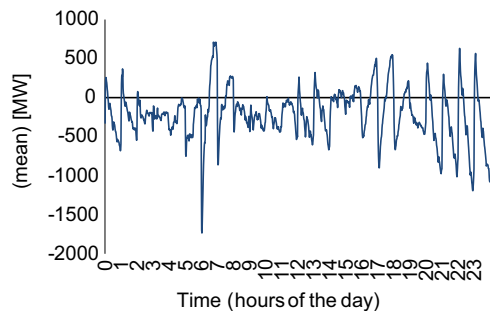


Fig. 4. Average German system imbalance for every minute of the day during the year 2011 (4 s-data from TSOs). One can identify clear patterns just before and after full hours. These schedule leaps are quite large compared to the size of reserves of about 4.5 GW. Schedule leaps can also be seen in observed grid frequency: frequency deviations are clustered around the full hours during the morning and the evening ramp http://www.netzfrequenz.info/auswertungen/langzeitverlauf-der-netzfrequenz.html/attachment/netzfrequenz_062011-122014; see also Weißbach and Welfonder [120].

physical variables. Deterministic sources of system imbalances can be forecast quite easily.

The probability of unplanned outages of power plants and transmission lines (contingencies) is a function of equipment characteristics (age, type) and operational decisions (maintenance, ramp rates). Similarly, the size of forecast errors is a function of resource characteristics (such as size and distribution of wind parks) and operational decisions (forecast quality, portfolio management). Operational decisions are subject to the economic incentive provided by the imbalance system (Section 5): if imbalance prices are high, owners will operate their assets in a way that forecast errors and outages rates will be reduced.

Load forecast errors are often assumed to be normally distributed [22]. Jost et al. [74] discuss characteristics of wind power and load forecast errors. Bruninx and Delarue [13] report that wind power forecast errors can be approximated well with a Lévy α -stable distribution. Zhang et al. [121] report that wind and solar power forecast errors are weakly negatively correlated; see also Braun et al. [10].

Next to these inherently stochastic processes, there is a deterministic source of imbalances: deviations resulting from the way contracts are designed in liberalized electricity markets. Schedules are specified as discrete step functions in intervals of, typically, 15 min. However, physical demand and supply changes

are smooth (Fig. 3). The differences between physical and scheduled values are called *schedule leaps*. These leaps apply to all types of portfolios and are substantial in size. Fig. 4 shows that schedule leaps are large and that deviations are greatest around full hours, indicating that many BRPs use hourly rather than quarter-hourly schedules (see [120,23]).

The literature often distinguishes two time scales in which imbalances occur: deviations of the dispatch interval mean from schedules (“forecast error”) and variations around the mean during the dispatch interval (“intra-dispatch interval variability” or “noise”). All four sources listed in Table 3 result in both forecast errors and noise.

3.3. Probabilistic reserve sizing in Germany

The German TSOs use a probabilistic approach to determine SC and TC capacities, sometimes called the “Graf/Haubrich approach” [22,23,85]. It is based on the idea of statistical convolution.

In statistical terms, the balancing area imbalance follows the joint distribution of the individual factors’ distribution functions and the reserve is set according to a pre-defined percentile (security level) of that function (Fig. 5).

According to the most recent publicly available document on reserve sizing in Germany [23], power plant outages are based on historical outage rates as reported by the VGB PowerTech database, schedule leaps are modeled, and forecast errors are estimated from historical system imbalances. The distribution functions of individual imbalance sources are not explicitly estimated.

3.4. Modeling the impact of VRE on reserve requirements

If VRE forecast errors are uncorrelated to other factors, additional wind and solar capacity *ceteris paribus* increases the size of balancing reserves. While some American studies argue that PC-type reserves would also increase [12], European studies usually find that only SC and TC reserves would be affected. An important assumption for any reserve impact study is the future improvement of generation forecasts, which are often assumed to be substantial.

UKERC [114, Holttinen et al. [68], and Brouwer et al. [12] provide surveys of the international modeling literature, being mostly studies of wind and solar integration. Holttinen et al. report that in predominately thermal power systems, most studies find that reserves increase by 2–9% of the additional wind capacity (20–90 MW per GW of wind power). Brouwer et al. report a wider range, but high estimates around 20% tend to arise in older studies. DLR [29] report 4% of additional VRE capacity in Germany, given a mix of solar and wind generation and significant improvements in forecast quality. DENA [27] report a higher value for Germany. NREL [96], a high-quality study for the Western United States, report a reserve increase of 4% of additional VRE capacity. De Vos et al. [119] assess wind power forecast errors in isolation and consequently find a much larger impact on reserves.

Ziegenhagen [122] provides a convolution-based assessment of the impact of VRE on reserve requirements. She finds that reserve requirements are increased by 6% of installed wind or solar capacity, assuming a moderate reduction of forecast errors by 30%. This number is reduced to 4% if both technologies are deployed simultaneously. Without forecast improvements, such a mixed expansion would increase reserve needs by 6.5%. If forecast errors are improved by 60%, the impact on reserves would be reduced to 1.5%. For up to 100 GW of additional capacity Ziegenhagen estimates the impact of reserve requirements to be roughly linear (Fig. 6).

While there is disagreement in the modeling literature about the size of the impact of VRE on balancing reserves, there is a consensus that additional VRE capacity increases the reserve requirement. In the following, we review empirical market data from Germany, which seems to prove this common knowledge to be wrong.

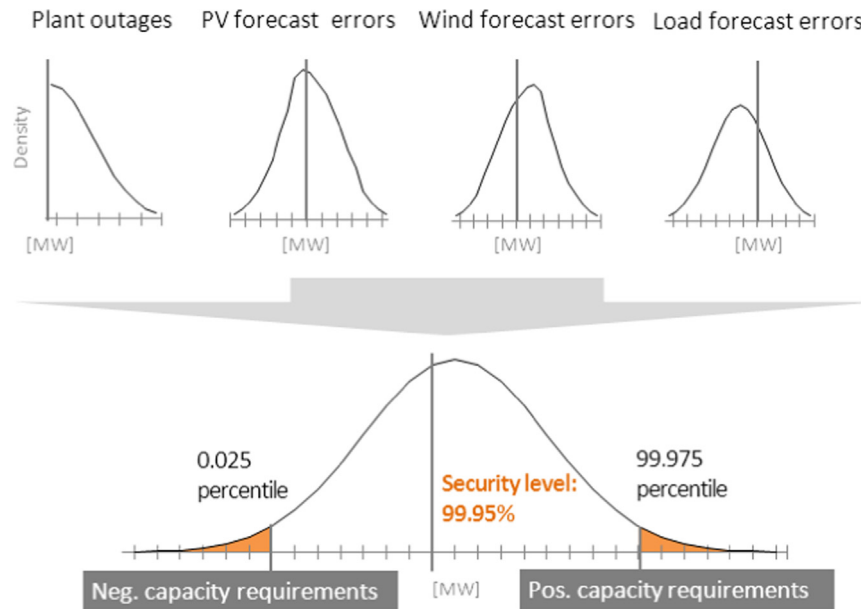


Fig. 5. Convolution-based reserve sizing. The stochastic convolution of different sources of imbalance results in the joint distribution function. The 0.025% and the 99.975% percentile of that function determine the required amount of reserves.

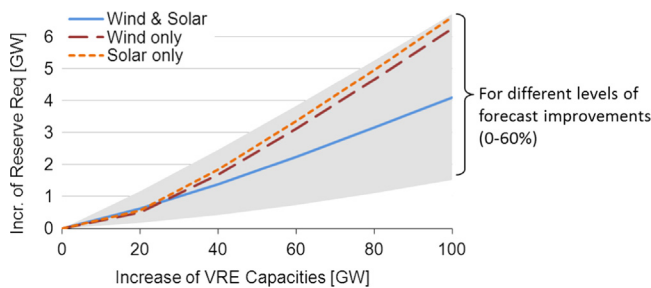


Fig. 6. The impact of additional VRE capacity on balancing reserve requirement as estimated by Ziegenhagen [122].

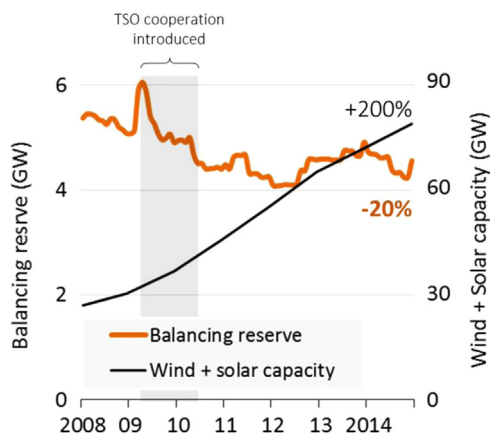


Fig. 7. Balancing reserves (SC+TC, average of positive and negative reserve) and VRE capacity (wind + solar) in Germany. Even though the installed capacity of wind and solar power has tripled since 2008, the demand for balancing power has decreased. One reason was the cooperation between TSOs introduced in 2009/2010.

3.5. The German experience: A paradox?

Since 2008, German VRE capacity has grown from 27 GW to 78 GW. Wind and solar power now deliver 15% of consumed electricity, up from 7% in 2008. Over the same period, TSOs *reduced* balancing

reserves by 15% (Fig. 7). This empirical fact seems to contradict common sense as well as the model results presented above.

Of course these descriptive statistics do *not* imply that additional wind and solar power reduce the balancing reserve requirement. What it does indicate is that other factors must have overcompensated for the VRE expansion. There are several candidates:

- improvements of wind and solar forecasts
- improvement of load forecasts
- reduced frequency of plant outages
- TSOs might have become more cost-conscious and decreased additional internal security margins
- TSO cooperation in reserve sizing
- improved intra-day market liquidity, and 15 min trading on power exchanges becoming common, allowing better portfolio management.

A quantitative assessment of these drivers is a promising direction of future research. Brouwer et al. [12] report that reserves did not increase in Denmark, Spain, and Portugal either, despite considerable VRE expansion.

During 2009/2010, the German TSOs established a balancing power cooperation (*Netzregelverbund*). Today, both reserve sizing and activation is done jointly such that Germany can, in practice, be treated as a single balancing area [123,124]. Since 2012, the Danish, Dutch, Swiss, Belgium, Czech, and Austrian TSOs have joined to form the “International Grid Control Cooperation” (IGCC). At this stage, the members outside Germany cooperate in terms of SC activation (imbalance netting), but size reserves individually.

In academic and policy circles, there seems to be widespread belief that wind and solar power have become major drivers for balancing power. This is reflected in the fact that there are numerous published studies that assess this relationship. Surprisingly, to the best of our knowledge, there is no *ex-post* estimation of the impact of the *Netzregelverbund* or studies that otherwise explain the decrease of the balancing reserve in Germany. More generally, the literature on the impact of the size of the balancing area on reserve requirements seems to be scarce (an exception is Milligan and Kirby [86]).

Reserve sizing is not a question of VRE alone, but of many more factors. Future studies should not assess the impact of VRE in

isolation, but take these other factors into account. Germany's historical experience also shows that it can be possible to decrease balancing reserves while increasing VRE capacity, if system operation is organized more efficiently.

3.6. Policy options: Advancing reserve calculations

To increase the economic efficiency of reserve sizing, several proposals have been made: dynamic sizing, specific solutions for deterministic imbalances, and price-elastic procurement.

Reserve requirements could be calculated dynamically, i.e. as a function of the current or expected system conditions [69,11,79]. Dynamic sizing is currently under assessment in Switzerland [1] and Germany [74]. Bucksteeg et al. [14] report that German reserve requirements are significantly larger during the day than at night.

Empirical data shows that schedule leaps cause significant deterministic imbalances (recall Fig. 4). The purpose of balancing power is to respond to *unexpected* events—but schedule leaps are known to occur every day at the same time. A dedicated approach to this source of imbalance seems more appropriate. One could mandate smoother transitions between dispatch intervals, shorten intervals [120,98], or introduce a dedicated ramping product [87]. We propose to use passive balancing, i.e. to use the imbalance price to incentivize BRPs to voluntarily stabilize the system (Section 5.5).

A third possibility of improvement concerns price-elastic sizing ([92]). If reserve prices are low, system operators should buy more to increase the level of reliability, and vice versa. As a side benefit, this would reduce the level of scarcity prices in energy-only wholesale markets [65].

Passive balancing and dynamic and price-elastic sizing all complement each other and all of them could be pursued. This section has discussed reserve sizing. TSOs then procure reserves on balancing power markets. We proceed by discussing these markets.

4. Balancing power market: Enabling VRE participation

Since TSOs do not own generation assets, they procure reserves on balancing power markets. Depending on the type of balancing power, suppliers receive a payment for capacity and/or energy, hence the price for balancing services is, in general, a two-part tariff. While capacity prices and energy prices for positive balancing are always non-negative (TSO pays the supplier), the energy price for negative balancing can be positive or negative (suppliers sometimes get paid for reducing output).

While the technical characteristics of different balancing power types are largely harmonized throughout the UCTE (Table 1), balancing power market design is national. A wide range of institutional setups exist, ranging from uncompensated supply obligation for generators, regulated or capped prices, mandatory offers by generators, to competitive voluntary bidding [41]. While almost all wholesale electricity prices feature marginal pricing, pay-as-bid pricing is common in balancing power markets. In contrast to wholesale electricity markets, balancing power is only demanded by the TSO, hence it is a single-buyer market.

Rebours et al. [102], ENTSO-E [36], Cognet and Wilkinson [20], and Fattler and Pellingner [42] compare market rules internationally. TenneT [112] compares the Dutch and the German market while Ela et al. [32] discuss American market design. van der Veen [117] discusses market design in the context of European Network Code development (recall Section 2.4). In the following, we will highlight relevant aspects of the German market design, report on recent market development, argue that VRE can cost-efficiently

supply negative balancing, and identify barriers to entry that have prevented VRE generators from participating.

4.1. Balancing power market design

German >balancing power market design is prescribed by the regulator and has been subject to frequent changes. Shortly after the liberalization of wholesale markets in 1989, balancing power markets were created in 2001, when bilateral contracts were replaced by public auctions. Since late 2007, the four German TSOs have used a common procurement platform⁹. Table 4 summarizes auction design as it has been in effect since mid-2011, after the latest reform.

TSOs have a perfectly price-inelastic demand for balancing power. Bidders have to prove that they can deliver balancing power according to technical requirements (Table 1) before being allowed to participate (“pre-qualification”)¹⁰. All auctions are pay-as-bid auctions (see [89,18,93]). Bids are accepted based on their capacity price only (*Leistungspreis*); dispatch is done according to the energy price (*Arbeitspreis*). Hence, there are two independent merit-orders. PC and SC are tendered for a week, TC for each day. PC is a symmetric (bi-directional) base product, which means both upward and downward regulation has to be provided for an entire week. SC is tendered separately as positive and negative reserves for peak and off-peak periods. TC is auctioned in blocks of 4 h, again, separately for negative and positive reserves. Hence there are four SC products and 12 TC products per auction. Minimum bid sizes apply, but pooling is allowed.

The number of pre-qualified suppliers has increased significantly during the past years (Fig. 8). Today, several “unconventional” suppliers such as municipal utilities, industrial consumers, aggregators, and foreign generators are pre-qualified for all three control power types¹¹. Bidding data is anonymous, such that the market share of new suppliers is unknown.

4.2. Market size and market development in Germany

We present empirical data of the German balancing power market in this section, for which we have compiled all balancing power bids since 2008¹². We discuss market size, price patterns of different types, and price trends.

Compared to the wholesale electricity market, balancing power is a niche market. Capacity payments were about €400 mn in 2014. For suppliers, this is the revenue potential of the balancing power market; for TSOs, this is the cost of capacity reservation. Divided over total electricity consumption, this corresponds to less than 0.8 €/MWh_{consumed}. In other words, of the household price of about 300 €/MWh_{consumed}, balancing power represents about 0.25% (Fig. 9). We estimate utilization costs to be € 200–300 million, hence capacity payments are about two thirds of the total costs for balancing; even including these costs, balancing services cost consumers little more than one €/MWh_{consumed}. For other countries, Rebours et al. [102] report that the balancing system costs 0.5–5% of the wholesale market for electrical energy,

⁹ At least four studies discuss the impact of this market design reform: Riedel and Weigt [127], Growtisch and Weber [52], Müller and Rammerstorfer [91], and Haucap et al. [56].

¹⁰ Pre-qualification criteria are described in the contract templates provided by the TSOs.

¹¹ List of prequalified bidders is given at www.regelleistung.net/ip/action/static/provider. In April 2013, the battery company Younicos announced the building of a 5 MW Li-On Battery to provide PC, www.yunicos.com/de/mediathek/pressemeldungen/013_2013_04_29_WEMAG.html.

¹² All data are publicly available at www.regelleistung.net, but are provided in somewhat inaccessible formats. A summary of current market developments can be found at <http://neon-energie.de/Regelleistungsmarkt-2014.pdf>.

Table 4
Balancing power market design in Germany.

	Primary control	Secondary control	Tertiary control
Auction period	Week	Week	Day
No. of products	1 (symmetric, base)	4 (pos/neg; peak/off-peak)	12 (pos/neg; blocks of 4 h)
Contract duration	Week	week (peak/off-peak)	4 h
Capacity payment	Yes	Yes	Yes
Energy payment	No	Yes	Yes
Minimum bid	1 MW	5 MW	5 MW
Number of suppliers	21	28	41

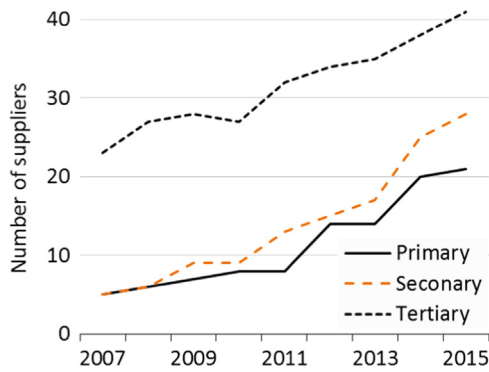


Fig. 8. The number of suppliers of balancing power has grown.

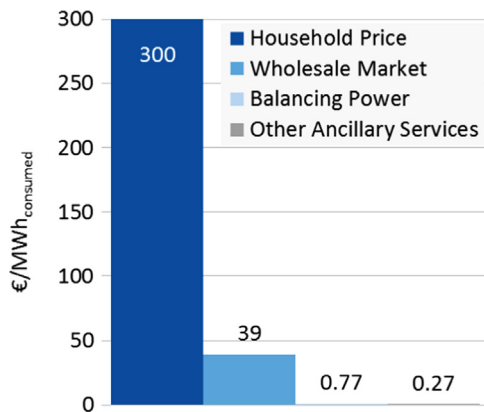


Fig. 9. The cost of balancing power provision is very small when compared to the wholesale market for energy or the retail prices. Source: own calculations, Bundesnetzagentur [17].

Table 5
Correlation of prices of SC products.
Source: own calculations; monthly capacity-weighted average prices 2008–2014.

	Peak	Off-peak	Positive	Negative
Peak	1			
Off-peak	0.20	1		
Positive	0.80	0.36	1	
Negative	0.14	0.88	0.02	1

consistent with the numbers reported here. [Cognet and Wilkinson \[20\]](#) find a similarly wide range of costs across European markets. Hence, balancing power is cheap compared to the total cost of the power system. In a sense, even if balancing is regarded as a problem for VRE deployment, economically, it is a small problem.

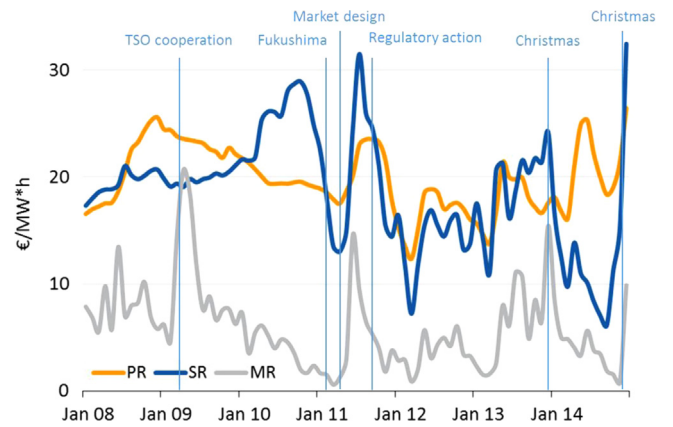


Fig. 10. Prices for balancing power are volatile. Demand shocks (TSO cooperation 2009), market design changes (2011) and expected low spot prices during Christmas (2013, 2014) led to price spikes.

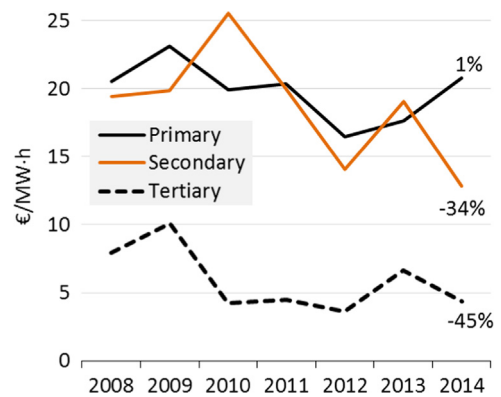


Fig. 11. Price for negative and positive balancing (yearly average, % change relative to 2008).

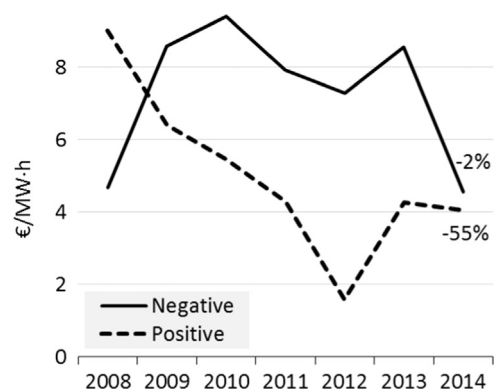


Fig. 12. Price by balancing power type (yearly average, only SC and TC, % change relative to 2008).

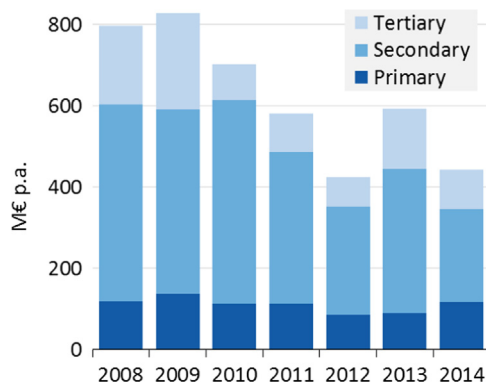


Fig. 13. The absolute size of balancing markets has decreased from €800 mn to €400 mn since 2008 (capacity payments only).

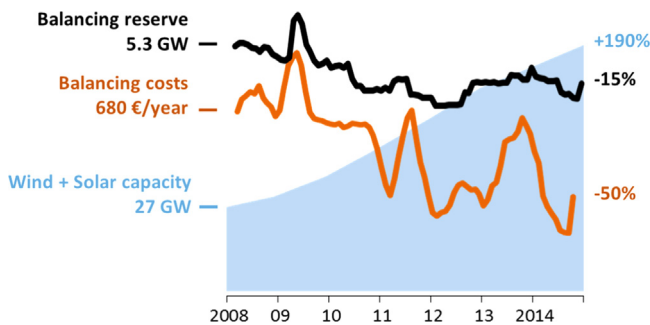


Fig. 14. While VRE capacity tripled, the balancing volume decreased by 15% and its costs by 50%.

PC and SC are more highly priced than TC, reflecting stricter technical requirements. As symmetric base products, PC and SC have been priced at about 20 €/MW h on average since 2008, and TC 6 €/MW·h. The fact that PC and SC are similarly priced confirms the impression that they are close technical substitutes (Table 1). Maybe surprisingly, negative balancing has been more expensive than positive balancing since 2010. The price of some products, notably positive TC, were practically zero. For both SC and TC, negative balancing tends to be more expensive in off-peak hours, while positive balancing is more expensive in peak hours. This pattern can be well explained by opportunity costs (Section 3.4). Moreover, peak prices are highly correlated with positive prices, and off-peak prices are highly correlated with negative prices (Table 5).

The prices for all three products are very volatile and price spikes occur (Fig. 10)¹³. Shocks have had dramatic impacts on prices, at least in the short term.

Since 2008, balancing prices have decreased significantly. Prices for TC declined more than for other products (Fig. 11) and prices for positive balancing decreased more than for negative balancing (Fig. 12).

Declining prices in conjunction with declining quantities has caused the market size to contract by half since 2008 (Fig. 13). This is bad news for suppliers, but good news for consumers. While VRE capacity has since tripled, volumes have decreased by 15%, as reported above, and costs have declined by 50% (Fig. 14). Of course, this does not indicate a causal relationship (*ceteris paribus*, more VRE capacity does not decrease costs). On the contrary, it indicates that there is *not* a one-to-one relationship: apparently VRE do not necessarily dominate balancing cost development, even during times of strong capacity expansion.

Explaining the evolution of prices is not trivial. Since 2008, the balancing power market has been affected by a number of shocks, which have all potentially influenced price development:

- contracted demand: this has potentially driven forecast improvements, TSO cooperation, and portfolio management which collectively outweigh the VRE capacity expansion (recall Section 3.5)
- supply shocks, such as the nuclear phase-out and the recession: these leave the wholesale market with much overcapacity that has entered balancing power markets
- lower margins on spot markets: these changed opportunity costs for thermal plants (Section 4.4)
- balancing markets becoming more competitive, possibly triggered by market design changes (recall Section 4.1; [56]) and regulatory intervention [53,57].

A more rigorous evaluation of the price development is a promising direction for further research. In the following, we indicate the drivers of the costs of thermal plants to reserve capacity for balancing, and argue that because of this cost structure, VRE would be an efficient supplier of downward balancing.

4.3. Providing balancing power with VRE generators

Wind and solar power are technically well suited for being ramped up or down very quickly, without significantly increasing maintenance costs or affecting the life-time of the plant, and with negligible IT costs [80,6,109,103,9,33,55]. In contrast, ramping of thermal plants causes temperature changes for boilers, tubes and turbines, which causes fatigue.

VRE generators can ramp down only in times when they produce electricity. To ramp up, they need to be operated below potential output, such that some generation is constantly curtailed. Consequently, while they can technically supply both positive and negative reserves, for economic reasons they are better suited to provide downward balancing.

To provide balancing capacity, one needs to use probabilistic generation forecasts to determine the share of output that is highly certain. Fraunhofer [45] has run a major joint project with German TSOs to assess the provision of balancing power by wind power. The share of wind power generation that is “firm enough” to participate in balancing power depends on the required security (probability) level and the relative size of the forecast error (without forecast errors, all generation could participate). The forecast error is a function of three major factors: (i) the size and geographic distribution of the pool of wind turbines, (ii) contract duration, and (iii) forecast horizon. A larger pool, shorter contract duration, and shorter forecast horizon reduce forecast errors. If all German wind turbines are pooled, contract duration is 1 h, and procurement occurs 1 h ahead. In more than 50% of all hours of the year wind power could supply all negative minute reserve that is required. With day-ahead auctions, this would be the case in only 10% of the hours. Görtz and Baumgart [55] apply a probability level of 99.994% and find that if all German wind power was pooled, an average of 30% of its output would be “firm”. The security level of 99.994% corresponds to the average availability of thermal plants that had bid in the balancing power market. Such forecasts are used in practice in Denmark, where wind power supplies balancing services [107].

Fraunhofer [45] also discusses the pros and cons of providing balancing power relative to a fixed schedule or relative to potential generation. Running wind turbines at fixed schedules means that some generation must be curtailed. Determining potential generation is not trivial, because of wake effects within wind parks.

¹³ During the Christmas week of 2013, 460 €/MW·h was paid for negative SC.

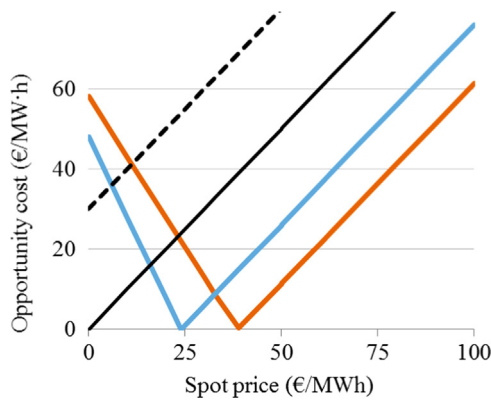


Fig. 15. Opportunity costs of providing positive balancing reserves. Depending on the price, technologies with low or with high variable costs have lower opportunity costs. Gas price 20 €/MWh, hard coal price 8 €/MWh, CO₂ 5 €/t, efficiencies for gas-fired combined cycle plant 55%, hard coal plant 40%, min load gas plant 30%, hard coal 40%, ramping range 20%.

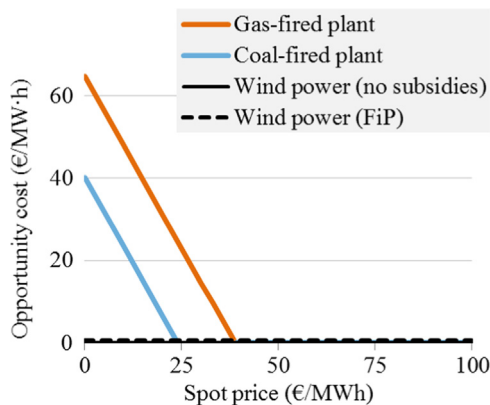


Fig. 16. Opportunity costs of providing negative balancing reserves. Technologies with lower variable costs have lower opportunity costs. Plants that are in the money have zero opportunity costs.

4.4. The opportunity costs of reserve provision: Why VRE should participate

We will show that a thermal plant's opportunity costs of reserving balancing capacity is a function of the spot price, and that costs are especially high at very low spot prices. Hence, whenever VRE generate much electricity (allowing them to provide balancing reserves), thermal plants can only supply at high cost. This is a strong argument for encouraging VRE generators to participate in balancing power markets.

The opportunity costs of reserve provision are determined by the foregone profit from sales on the spot market. They depend on (i) the foregone status of the generator, (ii) spot market spreads, (iii) ramping and cycling costs, and (iv) part-load efficiency losses. Opportunity costs are different for positive and negative balancing. A generator that is in the money (infra-marginal) can provide negative balancing power at zero cost, because with or without balancing power provision it would be dispatched at its rated capacity. To provide positive spinning reserves, the generator has to operate constantly below its rated capacity, resulting in reduced electricity sales and part-load efficiency losses. A generator that is out of the money (extra-marginal) has to remain online despite making losses; hence its opportunity costs are avoided losses.

Ignoring ramping costs and part-load efficiency, the opportunity costs of providing positive spinning reserve, C_t^+ , in hour t can be written as a function of the spot price p_t , the plant's variable cost c , minimum load P_{min} and the amount of balancing power the

plant can deliver, P_+ .

$$C_t^+ = \begin{cases} (p_t - c) & \text{if } p > c \\ -(p_t - c) \cdot P_{min}/P_+ & \text{if } p < c \end{cases} \quad (1)$$

The opportunity costs of providing negative reserve, C_t^- , can be written as this:¹⁴

$$C_t^- = \begin{cases} 0 & \text{if } p > c \\ -(p_t - c) \cdot (P_{min} + P_-)/P_- & \text{if } p < c \end{cases} \quad (2)$$

Figs. 15 and 16 illustrate opportunity costs of providing balancing reserves of plants with different variable costs: natural gas-fired power plants, coal-fired, and wind power.

At current European commodity prices, these plants have variable costs of around 40 €/MWh, 25 €/MWh, and zero, respectively. If the spot price equals variable costs, the power plant is at the money (marginal) and generators are indifferent to produce or not. The opportunity costs for positive balancing are zero (**Fig. 15**). At lower or higher spot prices, opportunity costs are positive. VRE generators have high opportunity costs because of low variable costs. The higher the foregone subsidy, the higher the opportunity costs of curtailing generation for the VRE generators. Only at very low or negative prices would it be efficient to use VRE generators to provide an upward balancing reserve.

In contrast, the opportunity costs of VRE for negative balancing (**Fig. 16**) are always zero. At low spot prices, the opportunity costs of thermal plants to provide balancing reserve become positive. During windy and sunny hours, VRE generation depresses the spot price, driving up the opportunity costs of thermal plants to provide negative balancing power. In other words, it is in the hours during which VRE generators are able to supply that thermal generators have high costs. In such hours it would be efficient to use VRE for downward balancing.

4.5. Policy options: Lowering entrance barriers

We have argued that VRE can efficiently supply negative balancing. However, even though the German renewable support system allows VRE to participate in balancing markets¹⁵, wind and solar power seem not to participate in significant volumes [82]. Apart from implementation issues [108,73,45], this seems to be because the design of balancing power markets constitutes a prohibitive entry barrier. Three options exist to lower entrance barriers: adjusting the balancing power auction design; introducing a second energy auction; fostering passive balancing. Lowering entry barriers is not only important for VRE generators, but also for demand side participation [7].

The ability of VRE to provide negative balancing power is limited to times when the primary energy is available. German balancing power auctions require the provision of PC and SC for a full week. Over that time horizon, weather forecasts are too uncertain for VRE to be able to provide firm reserves. Shorter auction periods are necessary for VRE participation. We propose daily auctions with a contract duration of 1 h, similar to day-ahead spot auctions. This setup is already used in Nordic and some Eastern European countries [41]. Böttger and Bruckner [128] estimate that this would reduce PC capacity costs by 11–13%. As a side benefit, it also improves the efficiency of thermal plant

¹⁴ The opportunity costs over contract duration T is the sum of each hour's costs, $C_T^+ = \sum_{t=1}^T C_t^+$. As spot prices vary, in different hours different generators have least opportunity costs. That is why longer contract duration causes inefficiencies.

¹⁵ Under the feed-in-tariff, VRE generators are not allowed to participate. Under the feed-in-premium, which now covers more than half of all capacity, they are allowed.

dispatch [75,94,14,110]. It would also reduce must-run of thermal plants [61], keeping up the spot price and mitigating the market value drop of wind and solar power [58,62]. In turn, larger quantities of renewables would be competitive [63]. The only costs involved are transaction costs, which could be reduced if the power exchange, rather than a proprietary platform, was used to procure balancing power.

In some countries, a second market for balancing energy opens after the balancing power auction is closed. In this “energy-only” market, generators are only rewarded with energy payments for providing balancing services. The gate closure of these markets is very short, such that bids can be submitted until shortly before real time. Denmark [35,125,107] and The Netherlands [112] are examples of such energy markets. TenneT argues that this feature is a key reason for lower costs in The Netherlands compared to Germany. It would augment the existing balancing market with an energy-only balancing market. ACER [3] proposes such a market in the “Balancing Energy” framework guideline. An alternative to energy markets is passive balancing, which we discuss in Section 5.5.

In addition, there are two proposals that would increase efficiency, but are unrelated to VRE-specific entry areas. Borggrefe and Neuhoff [8] and Sörös et al. [106] have proposed conditional bids. These are joint bids on spot and balancing power markets, for example offering balancing services only in those hours where plants are dispatched. Kahn et al. [76] and Müsgens et al. [126] argue that pay-as-bid pricing should be replaced by uniform pricing as it is more robust against uncertainty, reduces information asymmetry between companies, and mitigates market power. Several European countries use marginal pricing [41].

5. Imbalance settlement system: Setting the right incentives

Imbalance settlement occurs after the activation of balancing power (*ex post*). It involves two steps: the determination of the imbalance price, or “imbalance charge”, and the allocation of remaining costs or profits. The imbalance price is the price that BRP have to pay for being out-of-balance and is paid per MW h deviation from the submitted schedule (€/MW h_{deviation}), hence it is an energy price. This section discusses imbalance settlement, pricing rules, and the two ways in which the imbalance price can work as an economic incentive for VRE generators (and other market actors): improving forecasts, and passive balancing.

5.1. Imbalance settlement regimes

Imbalance price mechanisms are nationally regulated and differ along to differ in various aspects/with respect to, aber nicht along several dimensions [116,8,34,41]:

- two-price system (dual price) v. one-price system (single price)
- imbalance price calculated from balancing costs or from spot price
- whether or not capacity cost is included
- average v. marginal pricing
- cost-based or without punitive mark-ups (constant or variable costs; mark-ups at high imbalances, or minimal incentives)
- non-discriminatory pricing or a differentiated price for generators and loads
- settlement intervals: 15 min, 30 min, 60 min
- publication lag: time between end of settlement interval and publication of the imbalance price
- whether or not there is a legal obligation to be balanced.

The German imbalance pricing mechanism is determined by the regulator (*Bundesnetzagentur*) and has been adjusted several

times in recent years. Since May 2010, there has been a common German imbalance price (*Ausgleichsenergiepreis*, reBAP). The price is determined for settlement intervals of 15 min as the average dispatch cost (net energy payments divided by net balancing energy). The system is designed to be cost-neutral in the sense that all dispatch costs are borne by unbalanced BRPs. As the energy payment in the balancing power market is subject to pay-as-bid pricing, the imbalance price is generally different from the energy price in the balancing market; in general, it does not represent the marginal costs of activating balancing reserves.

Germany uses a non-discriminatory one-price system, hence short (undersupplied) and long (oversupplied) BRPs are settled with the same price. Apparently, however, the German regulator perceived the imbalance spread as being too low to provide a sufficiently strong incentive to deter imbalances [15,24]. Consequently, a punitive mark-up was introduced in late 2012¹⁶.

TSOs publish imbalance prices with a delay of several months. BRPs trade imbalances in the so-called “day after” market. In a one-price system this does not affect expected costs—but it reduces uncertainty. The costs for capacity reservation are socialized via grid fees, as in most European countries [41].

The relevant economic incentive for decisions that concern imbalances is the *imbalance spread*, being the difference between imbalance price and the corresponding day-ahead price. Usually, BRPs on the “wrong” side, i.e. those increasing (aggravating) the system imbalance, pay the imbalance spread, while BRPs that are on the “right” side earn a spread.

5.2. Estimates of VRE balancing costs

Numerous studies estimate the balancing costs of wind and solar power, i.e. the €/MW h cost for deviations from schedules. Holttinen et al. [68] and Hirth et al. [64] survey the literature on wind power, and Hirth [62] on solar power.

Model-based studies report costs to be between zero and 6 €/MW h, even at very high penetration rates of up to 40%. A linear trend of these estimates shows a moderate increase in balancing costs with wind penetration [54,111,51,105,26,113,50,68,88,48].

Studies that estimate balancing costs from observed imbalance prices show a very different picture: cost estimates vary between zero and 13 €/MW h and seem to be uncorrelated with penetration [66,99,97,67,77,30,64] (Fig. 17).

Peculiarities of balancing power markets and imbalance pricing might explain this apparent paradox. Market concentration can be high in balancing power markets and price variation can be large (Section 4). For example, balancing costs were 11 €/MW h in Austria in 2014, several times higher than in 2011, while costs remained stable in neighboring Germany [30]. Imbalance prices sometimes include punitive mark-ups that are unrelated to underlying costs (Section 5). This is one reason for the Dutch balancing cost of 9 €/MW h, as Pinson et al. [99] explain. One should be careful with generalizing cost estimates from tight markets or prices that do not reflect costs.

5.3. German imbalance prices

Fig. 18 displays the average imbalance spread for the years 2011–2014 as a function of the system imbalance (see also Table 6).

The positive correlation between the system imbalance and the imbalance price indicates that, overall, the pricing mechanism provides an economic incentive in the right direction. When the

¹⁶ Bundesnetzagentur BK6-12-024 published on 25 October 2012, www.transnetbw.de/downloads/strommarkt/bilanzkreismanagement/BK6-12-024_Beschluss_2012_10_25.pdf.

system was long, long BRPs lost on average 50 €/MW h, since they had paid 40 €/MW h on the day-ahead market, and received –10 €/MW h as an imbalance price. When the system was short, the imbalance spread was 52 €/MW h. In less than one percent of all quarter-hours the imbalance spread provided a perverse incentive to BRP, being negative in times of system undersupply or positive in times of system oversupply.

Surprisingly however, the imbalance price was only 35 €/MW h on average, while the day-ahead spot market price was 41 €/MW h. Hence, during these years, it would have been profitable – albeit unlawful – for a BRP to be constantly short. In other words, the imbalance market and the day-ahead market were not free of arbitrage opportunities. In one-price systems, imbalances are only costly if correlated with the system imbalance: an imbalance that is uncorrelated with the system imbalance pays an average imbalance spread of zero¹⁷.

Over the course of the day, the imbalance spread is everything but randomly distributed (Figs. 19 and 20). The first and last quarter-hour of each hour features significant deviation from the mean, especially during the morning and the evening ramps. For example, the average imbalance spread just before 7 a.m. is 32 €/MW h, and the average spread just

after 7 a.m. is –27 €/MW h. This pattern is rooted in schedule leaps (recall Fig. 4). We will argue below that BRPs should be allowed to respond to these price incentives and balance them passively.

5.4. The balancing price: an incentive for better forecasting

TSOs and regulators often view the imbalance price primarily from a cost allocation perspective, i.e. as a mechanism to recover the cost of utilizing balancing reserves. However, from an efficiency perspective, the crucial role of the imbalance price as an economic incentive to BRPs is to avoid (or not avoid) imbalances.

BRPs can reduce imbalances in many ways: by improving forecast tools, updating forecasts more frequently, shifting from hourly to 15 min scheduling, trading more actively on intra-day markets, and dispatching assets more accurately. Rational BRPs invest in such imbalance management measures up to the point where the marginal cost of reducing imbalances equals the

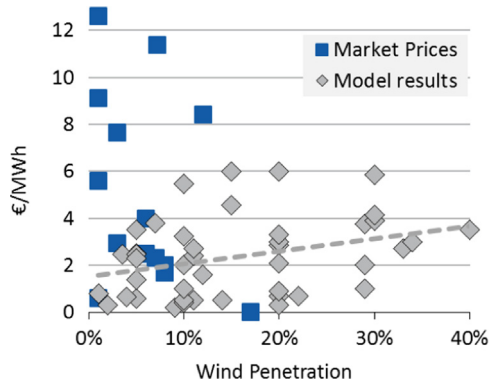


Fig. 17. Wind power balancing cost estimates from the literature (updated from [64]).

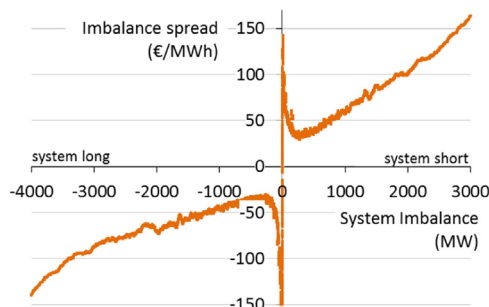


Fig. 18. Imbalance spread as a function of system imbalance, based on 140,000 quarter-hourly observations 2011–2014.

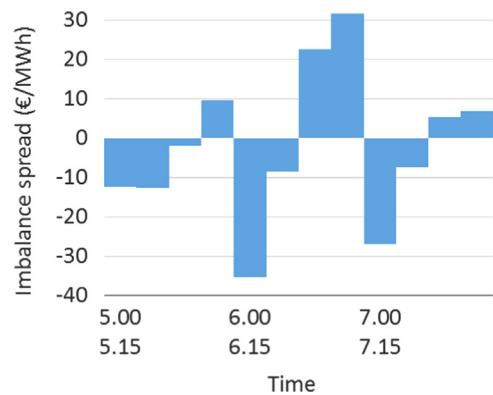


Fig. 19. The quarter-hourly imbalance spread during the morning ramp. Just before the full hour, the system is short, leading to positive spreads.

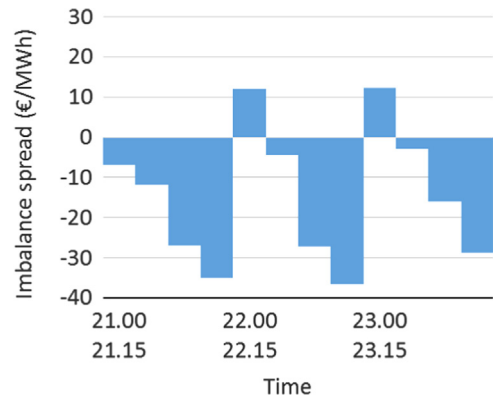


Fig. 20. The quarter-hourly imbalance spread during the evening ramp. Just before the full hour, the system is long, leading to negative spreads.

Table 6
Imbalance prices and incentive to BRPs.

	Average.	System long (60% of all hours)	System short (40% of all hours)	System very long (< –2000 MW) (4% of all hours)	System very short (> 2000 MW) (2% of all hours)
Imbalance price ^a	35 €/MW h	–10 €/MW h	94 €/MW h	–43 €/MW h	183 €/MW h
Day-ahead price ^a	41 €/MW h	40 €/MW h	42 €/MW h	39 €/MW h	50 €/MW h
Imbalance spread ^a	–7 €/MW h	–50 €/MW h	52 €/MW h	–82 €/MW h	132 €/MW h

^a Time-weighted average. Deviations caused by rounding.

Table 7
Policy options.

	Proposal	Intended effect
Reserve requirement (Section 3)	Dynamic sizing (currently static) Price-elastic procurement (currently inelastic) Specific measures for deterministic imbalances (currently all covered by balancing reserves)	More efficient sizing of reserves Increase security level in times of cheap reserves Use balancing only for stochastic imbalances
Balancing power market (Section 4)	Daily auctions (currently some weekly) Contract duration of 1 h (currently longer) Marginal pricing (currently pay-as-bid)	More suppliers (VRE and others) More suppliers (VRE and others) More robust against uncertainty, market power, information asymmetry
Imbalance settlement (Section 5)	Use power exchange for procurement (currently proprietary platform) Legalize passive balancing (currently illegal) Price publication within minutes (currently months) Marginal pricing (currently average) Reserve costs allocated via imbalance price (currently grid fees)	Reduce transaction costs Reduce system imbalance Allow BRPs to respond to price signal Economically efficient price signals to BRPs Economically efficient price signals to BRPs

marginal benefit of doing so, i.e. the imbalance spread. For statically and dynamically efficient resource allocation, the imbalance price should reflect the marginal economic costs of solving imbalances by means of balancing power. This is currently not the case.

Efficient resource allocation requires the imbalance price to represent *marginal*, not average, costs of balancing. The combination of pay-as-bid auctions on the balancing power market and average pricing on the imbalance market leads to inefficiently low imbalance prices. Hence, either pay-as-bid payment should be replaced by marginal pricing (for more reasons to do this, see 0), or the imbalance price should be based on marginal deployment costs.

Similarly, capacity costs should not be socialized, but borne by those BRPs that caused the need for reservation [116]. Given the practical difficulties of implementing such a pricing rule under uncertainty, a pragmatic approach could be to allocate these costs as a mark-up on the imbalance price. This would increase the imbalance spread by about 20 €/MW h¹⁸ in absolute terms. If reserves are sized to cover the loss of the largest unit, as is the case for PC, one might consider allocating capacity costs to this unit.

Setting the correct incentive might be more relevant for VRE generators than for other BRPs. Relative to their output, imbalances are larger for these than for other generators. Forecasting methodologies are relatively new and the potential for improvement seems to be vast, both for wind power [28,44,21,46,104,70] and solar power [19,43]¹⁹.

5.5. Passive and active balancing

When TSOs deploy balancing power, they *actively* balance the system. The price paid for this service is the capacity and the energy payment for balancing power. The imbalance price provides the incentive to BRPs to “*passively*” balance the system by purposely deviating from the schedule (“self-balancing”). TSOs can either actively balance the system by sending a dispatch signal to the suppliers of balancing power, or passively balance the system by sending a price signal to BRPs.

There are two preconditions for effective passive balancing: a timely publication of the imbalance price, and the legal ability for BRPs to respond to the price signal. Traditionally, the Dutch TSO

has used this mechanism quite heavily [112], while the German TSOs have followed a philosophy of active balancing. In fact, in Germany it is illegal for BRPs to be deliberately unbalanced—even if this stabilizes the system. The German regulator and TSOs expect BRPs to stick to their schedules, not to respond to price signals.

Passive balancing is a close substitute for active balancing, especially for slow reserves. Moreover, deterministic imbalances – such as schedule leaps – could be efficiently targeted by passive balancing. Fostering passive balancing could be an alternative (indeed, a very good substitute) to the introduction of energy-only balancing markets.

5.6. Policy options: The imbalance charge as price signal

There are three major sources of inefficiency in the German imbalance market: practical and legal barriers to passive balancing, and an inefficiently low imbalance spread.

Passive balancing should be encouraged. First, it needs to be legalized, and second, the imbalance price needs to be published shortly after real time. In France, Benelux, and the UK, prices are published within 1 h [41].

Imbalance prices should reflect the marginal costs of balancing. To do so, they should include the costs of holding reserves, and they should reflect the marginal cost of deploying them. Marginal pricing could be implemented by either switching to marginal pricing on balancing markets, or by adjusting the imbalance pricing formula accordingly. Average pricing and socializing capacity cost both tend to depress the imbalance spread. In other words, the German imbalance spread is currently inefficiently low. Current market rules constitute a positive externality: unbalanced actors do not bear the full costs of their action. The incentive that BRPs receive to keep their portfolio balanced is too weak. This implies that the incentive for VRE generators to improve forecasts is too weak.

6. Concluding remarks

This paper has discussed three interfaces between variable renewables and the balancing system: reserve requirements, participation of VRE generators in balancing markets, and the incentives provided by the imbalance price. These links interact and need to be considered jointly to explore the entire solution space of policy makers. Take the example of passive balancing: allowing BRPs to respond to price signals might be a good substitute for reforms of the balancing market, and could reduce the need for holding reserves.

We believe we can draw four broad findings from this study. First, the balancing reserve requirement depends on a multitude of factors; the wind and solar power forecast error is only one of

¹⁷ A simulation of hundred normally distributed imbalances resulted in an average imbalance spread of 0.01 €/MW h.

¹⁸ In 2011, the costs for positive and negative capacity reservation (excluding PC) were € 160 million and € 310 million, respectively. The amount of energy activated was 7 TW h and 18 TW h [16]. Allocating capacity costs through imbalance prices would have increased the imbalance spread by about 20 €/MW h, both in periods of undersupply and oversupply.

¹⁹ For solar power forecasting see also IEA Task 46, <http://task46.iea-shc.org/>.

several important drivers. Second, while German VRE capacity has tripled since 2008, reserves have been reduced by 15%. This indicates that other factors can be quantitatively more important than VRE, even in periods of strong capacity expansion. One can interpret this as an indication that balancing power is not necessarily a major barrier to VRE integration at moderate penetration rates. Third, the design of balancing power markets determines the incentives for VRE generators to provide balancing power themselves. Current market design constitutes a major barrier for participation. Finally, the design of imbalance settlement systems determines the incentives for BRPs to balance their portfolios. Specifically, it sets the incentives for VRE generators to produce accurate forecasts. Currently, the incentives for accurate forecasting are inefficiently low.

Throughout the paper we have also suggested a number of policy options, summarized in Table 7. We propose a switch to dynamic sizing and price-elastic reserve procurement. In the balancing power market, entry barriers for variable renewables should be lowered to stimulate participation. Specifically, we recommend shifting to daily auctions and hourly contracts, and switching from pay-as-bid to marginal pricing. In the area of imbalance settlement, we emphasize the role of the imbalance price as a price signal. Today, the imbalance price is often understood as a cost allocation mechanism, but we believe it should be viewed as a price signal. Passive balancing should be encouraged and prices should be published as close as possible to real time. We recommend including the costs of capacity reservation in the imbalance price.

References

- [1] Abbaspourtorbati, Farzaneh, Zima, Marek. Procurement of frequency control reserves in self-scheduling markets using stochastic programming approach: Swiss case. In: Proceedings of the 10th EEM conference, Stockholm; 2013.
- [2] ACER. Gas balancing in transmission systems framework guideline, (http://acernet.acer.europa.eu/portal/page/portal/ACER_HOME/Communication/News/FG%20Gas%20Balancing_final_public.pdf); 2011.
- [3] ACER. Framework guidelines on electricity balancing, (www.acer.europa.eu/Official_documents/Acts_of_the_Agency/Framework_Guidelines/Framework%20Guidelines/Framework%20Guidelines%20on%20Electricity%20Balancing.pdf); 2012a.
- [4] ACER. Framework guidelines on electricity system operation, (www.acernet.acer.europa.eu/portal/page/portal/ACER_HOME/Activities/FG_code_development/Electricity/FG-2011-E-003_02122011_Electricity%20System%20Operation.pdf); 2012b.
- [5] Bang, Christian, Felicia Fock & Mikael Togeby (2012): The existing Nordic regulating power market, Ea Energy Analyse, www.ea-energyanalyse.dk/reports/1027_the_existing_nordic_regulating_power_market.pdf.
- [6] Bömer, Jens. Vorbereitung und Begleitung der Erstellung des Erfahrungsberichtes 2011 gemäß § 65 EEG, (www.erneuerbare-energien.de/fileadmin/ee-import/files/pdfs/allgemein/application/pdf/eeg_eb_2011_netz_einspeisung_bf.pdf); 2011.
- [7] Böttger Dania, Götz Mario, Theofilidi Myrto, Bruckner Thomas. Control power provision with power-to-heat plants in systems with high shares of renewable energy sources—an illustrative analysis for Germany based on the use of electric boilers in district heating grids. *Energy* 2015;1–11 in press.
- [8] Borggreffe, Frieder, Neuhoff, Karsten. Balancing and intraday market design: options for wind integration. DIW discussion papers 1162; 2011.
- [9] Bossanyi, Ervin, Ghorashi, Ali. Active power control features in the wind turbine controller. In: Proceedings of the 12th wind integration workshop, London; 2013.
- [10] Braun, Axel, Fritz, Rafael, Otterson, Scott. Are forecast errors of wind and solar power statistically dependent? In: Proceedings of the 12th wind integration workshop, London, 2013.
- [11] Breuer, C., Engelhardt, C., Moser, A. Expectation-based reserve capacity dimensioning in power systems with an increasing intermittent feed-in. In: Proceedings of the 10th EEM conference, Stockholm; 2013.
- [12] Brouwer Anne Sjoerd, Machteld van den Broek Ad, Seebregts, Faaij André. Impacts of large-scale Intermittent Renewable Energy Sources on electricity systems, and how these can be modeled. *Renewable Sustainable Energy Rev* 2014;33(2014):443–66.
- [13] Bruninx Kenneth, Delarue Erik. A statistical description of the error on wind power forecasts for probabilistic reserve sizing. *IEEE Trans Sustainable Energy* 2014;5(3):995–1002.
- [14] Bucksteeg, Michael, Niesen, Lenja, Weber, Christoph. Auswirkungen situativer Regelleistungsbemessung auf die Vorhaltekosten. In: Proceedings of the IEWT 2015 Conference, Wien; 2015.
- [15] Bundesnetzagentur. Bericht zum Zustand der leitungsgelassenen Energieversorgung im Winter 2011/12, (www.bundesnetzagentur.de/SharedDocs/Downloads/DE/BNetzA/Presse/Berichte/2012/NetzBericht_ZustandWinter11_12.pdf); 2012a.
- [16] Bundesnetzagentur. Monitoringbericht 2012, (www.bundesnetzagentur.de/SharedDocs/Downloads/DE/BNetzA/Presse/Berichte/2012/MonitoringBericht2012.pdf); 2012b.
- [17] Bundesnetzagentur. Monitoringbericht 2014, Bundesnetzagentur, Bonn; 2014.
- [18] Chao Hung-Po, Wilson Robert. Multi-dimensional procurement auctions for power reserves: robust incentive-compatible scoring and settlement rules. *J Regul Econ* 2002;22(2):161–83.
- [19] Chen Yihsu, Tsao C, Campbell J. When renewable portfolio standards meet cap-and-trade regulations in the electricity sector: market interactions, profit implications, and policy redundancy. *Energy Policy* 2011;39(7):3966–74.
- [20] Cognet, Sylvain, Tracy Wilkinson. Balancing services in Europe. IHS Cera decision brief; 2013.
- [21] Colak Ilhami, Sagioglu Seref, Yesilbudak Mehmet. Data mining and wind power prediction: a literature review. *Renewable Energy* 2012;46:241–7.
- [22] Consentec. Gutachten zur Höhe des Regellenergiebedarfs, (www.bundesnetzagentur.de/cae/servlet/contentblob/102556/publicationFile/5861/Gutachten%20zur%20H%C3%B6he%20des%20Regellenergiebedarfs.pdf); 2008.
- [23] Consentec. Gutachten zur Dimensionierung des Regelleistungsbedarfs unter dem NRV, (www.consentec.de/wp-content/uploads/2012/01/Gutachten_zur_Hoehedes_Regellenergiebedarfs_2010.pdf); 2010.
- [24] Consentec. Weiterentwicklung des Ausgleichsenergie-Preissystems im Rahmen des Verfahrens BK6-12-024 der Bundesnetzagentur, (www.bundesnetzagentur.de/DE/DieBundesnetzagentur/Beschlusskammern/1BK-Geschaeftezeichen-Datenbank/BK6/2012/BK6-12-001bis100/BK6-12-024/BK6-12-024_consentec_Gutachten_2012_10_10.pdf); 2012.
- [25] Consentec. Beschreibung von Regelleistungskonzepten und Regelleistungsmarkt. Report for 50Hertz transmission GmbH, (http://www.consentec.de/wp-content/uploads/2014/08/Consentec_50Hertz_Regelleistungsmarkt_de_201402271.pdf); 2014.
- [26] DeMeo Edgar, Jordan Gary, Kalich Clint, King Jack, Milligan Michael, Murley Cliff, et al. Accommodating wind's natural behavior. *IEEE Power Energy Mag* 2007 November/December 2007.
- [27] DENA/Deutsche Energy Agentur GmbH. Grid study II: Integration of renewable energy sources in the German power supply system from 2015–2020 with an Outlook to 2025, (www.dena.de/en/projects/renewables/dena-grid-studyii.html); 2010.
- [28] DENA/Deutsche Energy Agentur GmbH. Integration der erneuerbaren Energien in den deutsch-europäischen Strommarkt, (www.dena.de/fileadmin/user_upload/Presse/Meldungen/2012/Endbericht_Integration_EE.pdf); 2012.
- [29] DLR/Deutsches Zentrum für Luft- und Raumfahrt, Fraunhofer Institut für Windenergie und Energiesystemtechnik, Ingenieurbüro für neue Energien. Langfristszenarien und Strategien für den Ausbau der erneuerbaren Energien in Deutschland bei Berücksichtigung der Entwicklung in Europa und global, (www.fvee.de/fileadmin/publikationen/Politische_Papiere_anderer/12.03.29.BMU_Leitstudie2011/BMU_Leitstudie2011.pdf); 2012.
- [30] e3 consult. Ausgleichsenergiekosten der Oekostrombilanzgruppe fuer Windkraftanlagen Endfassung. Study for Interessengemeinschaft Windkraft Österreich, (<https://www.igwindkraft.at/mmedia/download/2014.05.21/1400704191703835.pdf>); 2014.
- [31] Ela, Erik, Milligan, Michael, Kirby, Brendan. Operating reserves and variable generation. In: NREL technical report TP-5500-51978; 2011a.
- [32] Ela, Erik, Kirby, Brendan, Navid, Nivad, Smith, Charles. Effective ancillary services market designs on high wind power penetration systems. In: NREL conference paper CP-5500-53514; 2011b.
- [33] Ela, Erik, Gevorgian, V, Fleming, P, Zhang, Y, Singh, M, Muljadi, E, et al. Active power controls from wind power: bridging the gaps. In: NREL technical report TP-5D00-60574; 2014.
- [34] Elexon. Imbalance pricing guidance. A guide to electricity imbalance pricing in Great Britain, version 4.0, (www.elexon.co.uk/wp-content/uploads/2013/02/imbalance_pricing_guidance_v4.0.pdf); 2013.
- [35] Energinet.dk. Regulation C2. The balancing market and balance settlement, (<http://energinet.dk/EN/El/Engrosmarked/Viden-om-engrosmarkedet/Sider/Reserver-og-regulerkraft.aspx>); 2008.
- [36] ENTSO-E Survey on ancillary services procurement and electricity balancing market design, (www.entsoe.eu/fileadmin/user_upload/library/resources/BAL/121022_Survey_on_AS_Procurement_and_EBM_design.pdf); 2012a.
- [37] ENTSO-E NC load frequency control & reserve: overview last developments, (www.entsoe.eu/fileadmin/user_upload/library/resources/LCFR/120925_ENTSO-E_presentation_on_NC_LFC_R_update_final.pdf); 2012b.
- [38] ENTSO-E. Network code on load-frequency control and reserves, 28 June 2013, (www.entsoe.eu/major-projects/network-code-development/load-frequency-control-reserves); 2013.
- [39] ENTSO-E Network code on electricity balancing, 6 August 2014, (www.entsoe.eu/major-projects/network-code-development/electricity-balancing/); 2014a.

- [40] ENTSO-E Balancing pilot projects, (www.entsoe.eu/Documents/Network%20codes%20documents/Implementation/Pilot_Projects/141217_CBB_pilot_projects_overview.pdf); 2014b.
- [41] ENTSO-E. Survey on ancillary services procurement, balancing market design 2014, (https://www.entsoe.eu/fileadmin/user_upload/_library/publications/entsoe/ENTSO-E_2013_Survey_on_AS_Procurement_and_EBM_design.pdf); 2015.
- [42] Fattler, Stefen, Pelling, Christoph. Auswertungen und Analysen zur International Grid Control Cooperation. In: Proceedings of the ninth Internationale Energiewirtschaftstagung at TU Wien; 2015.
- [43] Fernandez-Jimenez L Alfredo, Muñoz-Jimenez Andrés, Falces Alberto, Mendoza-Villena Montserrat, Garcia-Garrido Eduardo, Lara-Santillan Pedro M, et al. Short-term power forecasting system for photovoltaic plants. *Renewable Energy* 2012;44:311–7.
- [44] Foley Aoife, Leahy Paul, Marvuglia Antonino, McKeogh Eamon. Current methods and advances in forecasting of wind power generation. *Renewable Energy* 2012;37:1–8.
- [45] Fraunhofer, ISE. Effekte regional verteilter sowie Ost-/West-ausgerichteter Solarstromanlagen. In: Report for Agora Energiewende, Berlin; 2014.
- [46] Freedman, J, Zack, J, Freedman, J, Cline, J, Flores, I, et al. The U.S. wind forecasting improvement project: results from the southern study area. In: Proceedings of the 12th wind integration workshop, London; 2013.
- [47] Fischechick M, Schaeffer R, Adedoyin A, Akai M, Bruckner T, Clarke L, et al. Mitigation potential and costs. In: Edenhofer O, Pichs-Madruga R, Sokona Y, Seyboth K, Matschoss P, Kadner S, Zwickel T, Eickemeier P, Hansen G, Schlömer S, Stechow C, editors. *IPCC special report on renewable energy sources and climate change mitigation*. Cambridge, UK: Cambridge University Press; 2011.
- [48] Garrige, E, Leahy, E. The value of accuracy in wind energy forecasts. In: Proceedings of the 12th international conference on environment and electrical engineering, Wrocław, 2013.
- [49] Gebrekiros Yonas, Doorman Gerard, Jaehnert Stefan, Farahmand Hossein. Reserve procurement and transmission capacity reservation in the northern European power market. *Electr Power Energy Syst* 2015;67(2015):546–59.
- [50] Gowrisankaran, Gautam, Reynolds, Stanley S, Samano, Mario. Intermittency and the value of renewable energy. In: NBER working paper 17086; 2011.
- [51] Gross, Robert, Heptonstall, Philip, Anderson, Dennis, Green, Tim, Leach, Matthew, Skea, Jim. The costs and impacts of intermittency: an assessment of the evidence on the costs and impacts of intermittent generation on the British electricity network, (www.uwig.org/mwg-internal/de5fs23hu73ds/progress?id=Gxdlkw+r0n); 2006.
- [52] Growsch, Christian, Weber, Christoph On the electricity reserves market redesign in Germany. In: CNL-working paper 2008-01; 2008.
- [53] Growitsch Christian, Höfler Felix, Wissner Matthias. Marktkonzentration und Marktmachtanalyse für den deutschen Regelenergiemarkt. *Z Energiewirtschaft* 2010;34(3):209–22.
- [54] Grubb Michael. Value of variable sources on power systems. *IEE Proc: Gener Transm Distrib* 1991;138(2):149–65.
- [55] Görtz Andreas, Baumgart Bastian. Windenergie am Regelleistungsmarkt. *Energiewirtschaftliche Tagesfragen* 2014;64(4):13–7.
- [56] Haucap Justus, Ulrich Heimeshoff, Dragan Jovanovic. Competition in Germany's Minute Reserve Power Market: An Econometric Analysis. *Energy J* 2012;35:139–58.
- [57] Heim, Sven. Do discriminatory auctions favor collusive behavior?—evidence from Germany's market for reserve power. In: Proceedings of the eighth IEWT conference, Vienna; 2013.
- [58] Hirth Lion. The market value of variable renewables. *Energy Econ* 2013;38:218–36.
- [59] Hirth, Lion, Ziegenhagen, Inka. Balancing power and variable renewables. In: FEEM working paper 2013.046; 2013a.
- [60] Hirth, Lion, Ziegenhagen, Inka. Die Rolle der Erneuerbaren am Regelleistungsmarkt neu definieren. *Energiewirtschaftliche Tagesfragen* 10/2013; 2013b.
- [61] Hirth, Lion. Minimal thermal generation in power systems—inferring private cost parameters from observed firm behavior. In: USAEE working paper 15-203; 2015a.
- [62] Hirth Lion. The market value of solar power: is photovoltaics cost-competitive? *IET Renewable Power Gener* 2015;9(1):37–45.
- [63] Hirth Lion. The optimal share of variable renewables. *Energy J* 2015;36(1):127–62.
- [64] Hirth Lion, Ueckerdt Falko, Edenhofer Ottmar. Integration costs revisited—an economic framework of wind and solar variability. *Renewable Energy* 2015;74:925–39.
- [65] Hogan, William. On an “energy only” electricity market design for resource adequacy. Working paper; 2005.
- [66] Holttinen Hannele. Optimal electricity market for wind power. *Energy Policy* 2005;33(16):2052–63.
- [67] Holttinen Hannele, Koreneff Göran. Imbalance costs of wind power for a hydropower producer in Finland. *Wind Eng* 2012;36(1):53–68.
- [68] Holttinen Hannele, Meibom Peter, Orths Antje, Lange Bernhard, Mark O'Malley, Olav Tande John, et al. Impacts of large amounts of wind power on design and operation of power systems. *Wind Energy* 2011;14(2):179–92.
- [69] Holttinen Hannele, Milligan Michael, Ela Erik, Menemenlis Nickie, Dobschinski Jan, Rawn Barry, et al. Methodologies to determine operating reserves due to increased wind power. *IEEE Trans Sustainable Energy* 2012;3(4):713–23.
- [70] Hong Tao, Pierre Pinson Shu Fan. Global energy forecasting competition 2012. *Int J Forecasting* 2014;30:357–63.
- [71] IEA (2014a): Advancing variable renewables—grid integration and the economics of flexible power systems. International Energy Agency, Paris; 2014a.
- [72] IEA. Renewable energy mid-term market outlook. International Energy Agency, Paris; 2014b.
- [73] Jansen, Malte, Speckmann, Markus, Scheider, Dominik, Siefert, Malte. Macro economic evaluation of proof methods for the delivery of balancing reserve by wind farms. In: Proceedings of the 12th wind integration workshop, London; 2013.
- [74] Jost, Dominik, Braun, Axel, Fritz, Refael. Sizing control reserves with a new dynamic method considering wind and photovoltaic power forecasts”. In: Proceedings of the 13th international Windintegration workshop; 2014. p. 438–443.
- [75] Just Sebastian. Appropriate contract durations in the German markets for on-line reserve capacity. *J Regul Econ* 2010;39(2):194–220.
- [76] Kahn A, Peter Cramton R, Porter, Tabors R. Uniform pricing or pay-as-bid pricing: a dilemma for California and beyond. *Electr J* 2001;14(6):70–9.
- [77] Katzenstein Warren, Apt Jay. The cost of wind power variability. *Energy Policy* 2012;51:233–43.
- [78] KEMA & REKK. Study on methodologies for gas transmission network tariffs and gas balancing fees in Europe, (http://ec.europa.eu/energy/gas_electricity/studies/doc/gas/2009_12_gas_transmission_and_balancing.pdf); 2009.
- [79] Kippelt, Stefan, Thorsten Schlüter, Rehtanz, C. Flexible dimensioning of control reserve for future energy scenarios. In: Proceedings of the IEEE PowerTech 2013, Grenoble; 2013.
- [80] Kirby, Brendan, Milligan, Michael, Erik, Ela. Providing minute-to-minute regulation from wind plants. In: NREL conference paper CP-5500-48971; 2010.
- [81] Knopf Brigitte, Bakken Bjorn, Carrara Samuel, Kanudia Amit, Keppo Ilkka, Koljonen Tiina, et al. Transforming the European energy system: member states' prospects within the EU framework. *Clim Change Econ* 2013;4(S1):1–26.
- [82] Köpke Ralk. *Umkämpfter Direktstrommarkt*. *Energy Manage* 2013 March 1.
- [83] Kristiansen Tarjei. The Nordic approach to market-based provision of ancillary services. *Energy Policy* 2007;35(7):3681–700.
- [84] Luderer Gunnar, Krey Volker, Calvin Katherine, Merrick James, Mima Silvana, Pietzcker Robert, et al. The role of renewable energy in climate stabilization: results from the EMF27 scenarios. *Clim Change* 2014;123(3–4):427–41.
- [85] Maurer Christoph, Krahl Simon, Weber Holger. Sizing of secondary and tertiary control reserve by probabilistic methods. *Eur Trans Electr Power* 2009;19(4):544–52.
- [86] Milligan, Michael, Kirby, Brendan. Calculating wind integration costs: separating wind energy value from integration cost impacts. In: NREL technical report TP-550-46275; 2009.
- [87] Milligan, Michael, Kirby, Brendan, Gramlich, R, Goggin, M.. Impact of electric industry structure on high wind penetration potential. In: NREL technical report TP-550-46273; 2009.
- [88] Mills, Andrew, Wiser, Ryan. Changes in the economic value of variable generation at high penetration levels: a pilot case study of California. In: Lawrence Berkeley National Laboratory paper LBNL-5445E, Lawrence Berkeley National Laboratory; 2012.
- [89] Morey Mathew. *Power market auction design*. Washington: Edison Electric Institute; 2001.
- [90] Mott MacDonald & SWECO. Impact assessment on European electricity balancing market. United Kingdom: Mott MacDonald; 2013.
- [91] Müller Gernot, Rammerstorff Margarethe. A theoretical analysis of procurement auctions for tertiary control in Germany. *Energy Policy* 2008;36:7.
- [92] Felix Müsgens, Ockenfels Alex. Design von Informationsfeedback in Regelleistungsmärkten. *Z Energiewirtschaft* 2011;35(4):249–56.
- [93] Müsgens Felix, Ockenfels Axel, Peek Markus. Economics and design of balancing power markets in Germany. *Electr Power Energy Syst* 2014;55:392–401.
- [94] Müsgens Felix, Ockenfels Alex, Peek Markus. Balancing power markets in Germany: timing matters. *Z Energiewirtschaft* 2012;36:1–7.
- [95] NERC. Reliability standards, www.nerc.com/page.php?cid=2120; 2012.
- [96] NREL. Western wind and solar integration study phase 2. Golden, CO: National Renewable Energy Laboratory; 2013.
- [97] Obersteiner, Carlo, Siewierski, T, Andersen, AN. Drivers of imbalance cost of wind power: a comparative analysis. In: Proceedings of the seventh European energy markets conference, Madrid; 2010.
- [98] Pérez-Arriaga Ignacio, Battle Carlos. Impacts of intermittent renewables on electricity generation system operation. *Energy J* 2012;1(2):3–17.
- [99] Pinson Pierre, Chevallier Christophe, Kariniotikas George. Trading wind generation from short-term probabilistic forecasts of wind power. *IEEE Trans Power Syst* 2007;22(3):1148–56.
- [100] REN21. Renewables 2014 global status report. REN21 Secretariat, Paris; 2014.
- [101] Rebours Yann, Kirschen Daniel, Trotignon Marc, Rossignol Sébastien. A survey of frequency and voltage control ancillary services—Part I: Technical features. *IEEE Trans Power Syst* 2007;22(1):350–7.
- [102] Rebours Yann, Kirschen Daniel, Trotignon Marc, Rossignol Sébastien. A survey of frequency and voltage control ancillary services—Part II: Economic features. *IEEE Trans Power Syst* 2007;22(1):358–66.

- [103] Saiz-Marin E, Garcia-Gonzalez J, Barquin J, Lobato E. Economic assessment of the participation of wind generation in the secondary regulation market. *IEEE Trans Power Syst* 2012;27(2):866–74.
- [104] Siefert, M, Dobschinski, J, Wessel, A, Hagedorn, R, Lundgren, K, Majewski, D. Development of innovative weather and power forecast models for the grid integration of weather dependent energy sources. In: Proceedings of the 12th wind integration workshop, London; 2013.
- [105] Smith Charles, Milligan Michael, DeMeo Edgar, Parsons Brian. Utility wind integration and operating impact state of the art. *IEEE Trans Power Syst* 2007;22(3):900–8.
- [106] Sörös, Péter, Raisz, Dávid, Divényi, Dániel. Day-ahead market design enabling co-optimized reserve procurement in Europe. In: Proceedings of the 11th European energy market conference, Kraków; 2014.
- [107] Sorknaes Peter, Andersen Anders N, Tang Jens, Strom Sune. Market integration of wind power in electricity system balancing. *Energy Strategy Rev* 2013;1(2013):174–80.
- [108] Speckmann, Markus. Windkraftanlagen als Teilnehmer am Regelenergiemarkt. In: Paper presented at the Euroforum-Konferenz Regelenergiemarkt 2013, Berlin; 2013.
- [109] Speckmann, Markus, Baier, André, Siefert, Malte, Jansen, Malte, Schneider, Dominik, Bohlen, Werner, et al. Provision of control reserve with wind farms. In: Proceedings of the 11th German wind energy conference, Bremen; 2012.
- [110] Sprey, Jens., Dress, Tim, vom Stein, Denis, Moser, Albert. Potential einer Harmonisierung der europäischen Regelleistungsmärkte. In: Proceedings of the ninth international Energiewirtschaftstagung at TU Wien, (http://www.eeg.tuwien.ac.at/eeg.tuwien.ac.at_pages/events/jiewt/jiewt2015/uploads/abstracts/A_16_Sprey_Jens_12-Oct-2014_14-36.pdf); 2015.
- [111] Strbac Goran, Shakoor Anser, Black Mary, Pudjianto Danny, Bopp Thomas. Impact of wind generation on the operation and development of the UK electricity systems. *Electr Power Syst Res* 2007;77:1214–27.
- [112] TenneT. Imbalance management TenneT analysis report, (www.tennetso.de/site/binaries/content/assets/transparency/publications/tender-of-balancing-power/imbalance-management-tennet-analysis-report.pdf); 2011.
- [113] Tuohy Aidan, Meibom Oeter, Denny Eleanor, Mark O'Malley. Unit commitment for systems with significant wind penetration. *IEEE Trans Power Syst* 2009;24(2):592–601.
- [114] UKERC/UK Energy Research Centre. The costs and impacts of intermittency: an assessment of the evidence on the costs and impacts of intermittent generation on the British electricity network. In: Robert Gross, Philip Heptonstall, Dennis Anderson, Tim Green, Matthew Leach, Jim Skea, editors; 2006.
- [115] UCTE. Operation handbook, (www.entsoe.eu/publications/system-operations-reports/operation-handbook/); 2009.
- [116] Vandezande Leen, Meeus Leonardo, Belmans Ronnie, Saguan Marcelo, Glachant Jean-Michel. Well-functioning balancing markets: a prerequisite for wind power integration. *Energy Policy* 2010;38(7):3146–54.
- [117] van der Veen Reinier. Designing multinational electricity balancing markets. PhD thesis. TU Delft; 2013.
- [118] van der Veen, Reinier, Abbasy, Alireza, Hakvoort, Rudi. A comparison of imbalance settlement designs and results of Germany and the Netherlands. In: Proceedings of the YEEES seminar, Cambridge; 2010.
- [119] De Vos Kristof, Morbee Joris, Driesen Johan, Belmans Ronnie. Impact of wind power on sizing and allocation of reserve requirements. *IET Renewable Power Gener* 2012;7:1–9.
- [120] Weißbach Tobias, Welfonder Ernst. High frequency deviations within the European power system—origins and proposals for improvement. *VGB PowerTech* 2009 6/2009.
- [121] Zhang J, Hodge B, Florita A. Joint probability distribution and correlation analysis of wind and solar power forecast errors in the western interconnection. *J Energy Eng* 2015;141 SPECIAL ISSUE: Smart Grid and Emerging Technology Integration.
- [122] Ziegenhagen Inka. Impact of increasing wind and PV penetration rates on control power capacity requirements in Germany. Master's thesis. University of Leipzig; 2013.
- [123] Zolotarev Pavel, Treuer M, Weißbach Tobias, Gökeler Melchior. Netzregelverbund, Koordinierter Einsatz von Sekundärregelleistung. *VDI-Berichte* 2009:2080.
- [124] Zolotarev, Pave, Gökeler, Melchior. Netzregelverbund—Koordinierter Einsatz von Sekundärregelleistung". In: Proceedingsofthe 10. ETG/GMM-Fachtagung "Netzregelung und Systemführung", Munich; 2011.
- [125] Andersen, Anders, Sune Strøm, Jens Tang, Troels Davidsen & Niels Dupont (2012): "Proactive participation of wind turbines in the balancing markets", Paper presented at EWEA conference.
- [126] Müsgens, Felix, Alex Ockenfels & Markus Peek (2011): "Economics and Design of Balancing power Markets in Germany", r2b working Paper, www.r2b-energy.eu/uploads/pdf/publikationen/WP_2011_01.pdf.
- [127] Riedel, Stefen & Hannes Weigt (2007): "German Electricity Reserve Markets", Electricity Markets Working Papers WP-EM-20.
- [128] Böttger, Diana & Thomas Bruckner (2015): "Market design improvements in the German balancing power market – A fundamental model analysis", Proceedings of the 10th ENERDAY Conference on Energy Economics and Technology.