

# Energy Economics, Winter Semester 2025-6 Lecture 9: The Electricity Grid

Prof. Tom Brown, Philipp Glaum

Department of Digital Transformation in Energy Systems, Institute of Energy Technology, TU Berlin

Unless otherwise stated, graphics and text are Copyright ©Tom Brown, 2021-5. Graphics and text for which no other attribution are given are licensed under a Creative Commons Attribution 4.0 International Licence.

#### **Table of Contents**



- 1. Introduction to Grid Congestion
- 2. Trading Between Regions
- 3. Redispatch
- 4. Balancing Power
- 5. Distribution Grids
- 6. Network Fees
- 7. Electricity Retail Markets


Introduction to Grid Congestion

#### Lecture 3: Benefits of Trade



Thus far we have looked at electricity markets in **isolation** from each other, while also **ignoring grid physics**.


Recall: Trade between 2 regions always leads to a **welfare gain** (WFG) in each country, but can have a strong influence on the distribution between the consumer and producer surpluses.

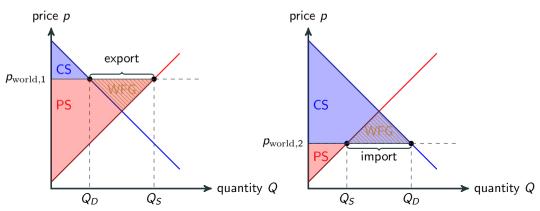

#### Lecture 4: Electricity grids: technical overview



Grid takes electricity from generators to consumers. Long distance transport: **transmission network** at high voltages (> 110 kV). Shorter distance transport: **distribution network** at lower voltages ( $\le 110 \text{ kV}$ ). In houses usually 230 V.

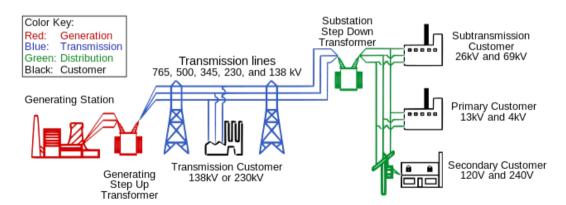


# Lecture 4: Electricity grids: technical overview



The European transmission network is mostly at 220 kV (green) and 380 kV (red). Purple lines are undersea high voltage direct current (HVDC) cables.


The capacity of each transmission line is **constrained** because of thermal and voltage limits.

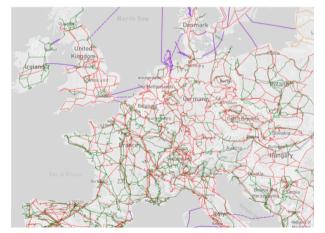


#### Lecture 4: What happens when things go wrong



In November 2006, the continental European system split into three parts. Since before the split 10 GW was being transferred from East to West, in the West there was a generation deficit, which caused a frequency drop, while in the East there was an oversupply, causing a frequency spike.

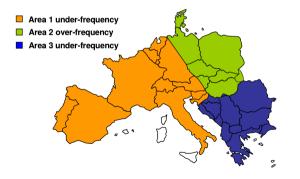



#### Questions we want to answer



- How can we take account of trade between regions in electricity markets?
- How do we deal with grid constraints between regions?
- How do we deal with grid constraints within regions?
- What incentives are there for grid operators to expand their networks?
- How do we incentivise the provision of grid services (frequency regulation, voltage stability, black start capability, covering resistive losses)?

**Trading Between Regions** 

#### **Existing bidding zones**





- Bids for German electricity take place in a bidding zone encompassing both Germany and Luxembourg (Austria was separated from the German bidding zone in October 2018)
- Other countries have their own bidding zones or are split into several bidding zones (see Nordic countries and Italy)
- This means that transmission constraints are only visible to the market at the borders between the bidding zones
- Internal transmission constraints are ignored market bids are handled as if they do not exist (see next section on congestion management)

## European single market for electricity



**Goal:** Creation of a single market for electricity in Europe.

#### Benefits are numerous:

- Increase in overall welfare since low-cost regions can export to high-cost regions
- Level out price differences between bidding zones
- Strengthen competition between suppliers
- Economies of scale for power plants
- Improve **system integration** of variable RES (balance variable feed-in over larger area, allow integration of best wind and solar sites)
- Improve network security by sharing system service resources (e.g. control power)
- Backup generation available in case of a power plant failure
- More uniform aggregated load leads to more regular power plant operation

## European single market for electricity



But: Technical constraints lead to congestion.

Congestion occurs when a market transaction between two regions is limited by the technical exchange capacity between the regions.

Adequate allocation of the scarce resource of transmission capacity is called **congestion management**.

#### **Pre-emptive measures:**


- Explicit auctions of capacity between bidding zones
- Implicit auctions of capacity between bidding zones

#### **Curative measures:**

• Redispatch of power plants within the bidding zones

#### Capacity constraints between bidding zones



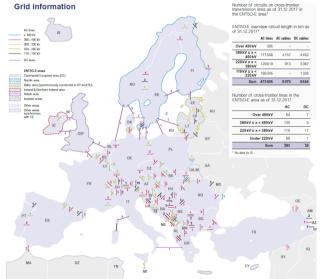

- Capacity constraints between bidding zones are determined for each border depending on capacities at the border and any other limiting transmission lines inside each bidding zone
- Capacities can be different in different directions (exports versus imports)
- Some borders have alternating current (AC) and some direct current (DC)
- Central and Western Europe has more advanced flow-based market coupling

#### Trade among different bidding zones




- If the price between two or more bidding zones is not the same, **arbitrage** is possible (buying power in the lower-cost zone and selling it in the higher-cost zone)
- If there is no limit on trade, prices will equalise
- However, trade is typically limited by interconnection capacity
- If the interconnection capacity is limited, prices may not equalise, giving rise to congestion rent, which is the price difference multiplied by the flow of electricity between the regions

#### Trading without congestion caused by transmission constraints



Before trading, the price in Market A, PA, is lower than that in Market B, PB.

After trading, Market A exports to B and the prices equalise  $PA^* = PB^*$ .

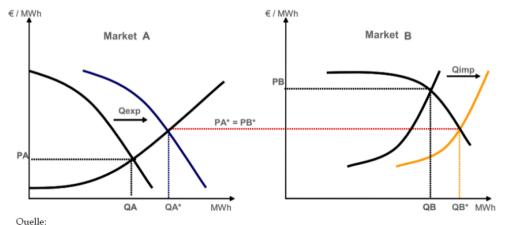

Epex Spot SE


**Exporting Market** 

**Importing Market** 

# Trading with congestion caused by transmission constraints




If a transmission line causes a capacity constraint that limits price arbitrage, prices converge but do not equalise. We have **congestion**. The product of the flow and the price difference is the **congestion rent**,  $\Delta P \cdot F$ . (ATC is the **Available Transmission Capacity**.)

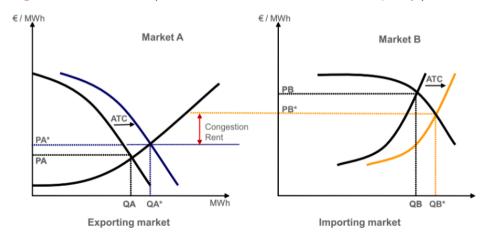

#### Prices over time



Trading will cause prices to converge over time.

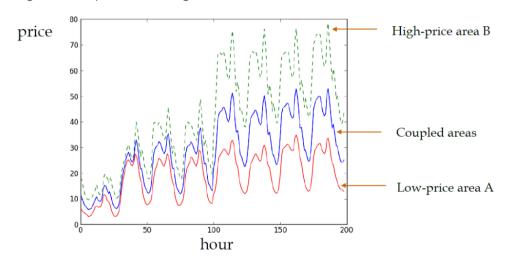

# Example: two nodes with completely inelastic demand



Now consider the connection of two nodes i with their own electricity supply curves  $P_i(Q_i)$  and completely inelastic demand (i.e. a vertical demand curve)  $Q_i^B$ , with a line with capacity K.



Node 1

demand:  $Q_1^B = 500 \text{ MW}$ 

supply:  $P_1(Q_1) = 10 + 0.01 \cdot Q_1$ 

Node 2

demand:  $Q_2^B = 1500 \text{ MW}$ 

supply:  $P_2(Q_2) = 13 + 0.02 \cdot Q_2$ 

Note that electricity is cheaper at node 1 than node 2.

We can determine the flow exported from node 1 and imported to node 2:

$$F = Q_1 - Q_1^B = Q_2^B - Q_2$$

#### Case 1: no transmission capacity K = 0



First suppose there is no transmission capacity between the nodes, K = 0. This is the same as having separate markets.

For each node *i* we have demand equal to supply

$$Q_i = Q_i^B$$

The price at each node is set by the intersection of the (vertical) demand curve and the supply curve.

For the first node  $Q_1^B = 500$  so the price is

$$P_1(Q_1^B) = P_1(500) = 10 + 0.01 \cdot 500 = 15$$

For the second node  $Q_2^B=1500$  so the price is


$$P_2(Q_2^B) = P_2(1500) = 13 + 0.02 \cdot 1500 = 43$$

#### Case 1: no transmission capacity K = 0



We can draw this on a single graph by plotting the supply curve for node 1 from the left axis, and the supply curve from node 2 from the right axis. We will always have (regardless of transmission)

$$Q_1^B + Q_2^B = Q_1 + Q_2 = 2000$$

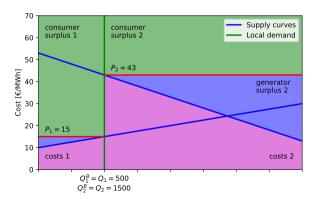

## Case 2: unlimited transmission capacity $K = \infty$



Now suppose there is unlimited transmission, so that the two markets merge. Now there is a single demand  $Q_1 + Q_2 = 2000$  and a single clearing price. The generators adjust their output until the prices equalise:

$$P_1(Q_1) = P_2(Q_2) = P_2(2000 - Q_1)$$

We solve this to find  $Q_1$ :

$$10 + 0.01 \cdot Q_1 = 13 + 0.02 \cdot (2000 - Q_1)$$


 $\Rightarrow$  0.03 ·  $Q_1$  = 43  $\Rightarrow$   $Q_1$  = 1433 MW,  $Q_2$  = 2000 −  $Q_1$  = 567 MW and the common clearing price is  $P = P_1(Q_1) = P_2(Q_2) = 24.33$  €/MWh.

# Case 2: unlimited transmission capacity $K = \infty$



We can draw this on our graph, but now the transmission means  $Q_i \neq Q_i^B$  since node 1 exports electricity to node 2. The power flow F from node 1 to 2 is

$$F = (Q_1 - Q_1^B) = -(Q_2 - Q_2^B) = (1433 - 500) = -(567 - 1500) = 933$$

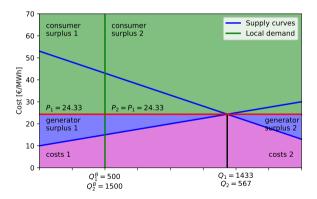

#### Case 2: constrained transmission capacity K = 400 MW



Now suppose the transmission capacity is less than the power flow occuring for a single market with unconstrained transmission. The (cheaper) generators at node 1 export power until the line is **congested**. The (more expensive) generators then cover the remaining load at node 2.

We find two separate prices:

$$P_1(Q_1^B + K) = P_1(500 + 400) = 10 + 0.01 \cdot 900 = 19$$
  
 $P_2(Q_2^B - K) = P_2(1500 - 400) = 13 + 0.02 \cdot 1100 = 35$ 


This leads to  $Q_1 = 900$  MW,  $P_1 = 19 \in /MWh$ ,  $Q_2 = 1100$  MW,  $P_2 = 35 \in /MWh$  and flow equal to capacity F = K = 400 MW.

## Case 2: constrained transmission capacity K = 400 MW




The **congestion rent** is now visible in the middle (flow times price difference), since there is welfare which is neither generator nor consumer surplus.


This money goes to the network operator for providing the arbitrage opportunity via the network.

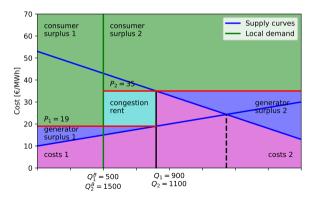


## Outcomes for different values of transmission capacity K







$$K = 400, F = 400$$
  
 $Q_1^* = 900, Q_2^* = 1100$ 



# **Example: Summary**



	1: Separate markets	2: Single market	3: Constrained market
$Q_1^B$ [MW]	500	500	500
$Q_1$ [MW]	500	1433	900
$P_1 \in MWh$	15	24.33	19
$Q_2^B$ [MW]	1500	1500	1500
$Q_2$ [MW]	1500	567	1100
P <sub>2</sub> [€/MWh]	43	24.33	35
$F_{1 o 2}$ [MW]	0	933	400
$\sum_i P_i \times Q_i \in [h]$	72000	48660	55600
$\sum_i P_i \times Q_i^B \in [h]$	72000	48660	62000
$(P_2-P_1)*F_{1\to 2}\ [\in/h]$	0	0	6400

#### **Congestion rent**



Due to the congestion of the transmission line, the marginal cost of producing electricity is different at node 1 and node 2. The competitive price at node 2 is higher than at node 1.

Since consumers pay and generators get paid the price in their local market, in case of congestion there is a difference between the total payment of consumers and the total revenue of producers – this is the **merchandising surplus** or **congestion rent**, collected by the transmission system operator. For each line it is given by the price difference in both regions times the amount of power flow between them:

Congestion rent 
$$= \Delta P \times F$$

#### **Example: Congestion rent for different values of** *K*




The congestion rent for the two-node example is given by

Congestion rent = 
$$|P_1 - P_2| \times |F|$$

It is also the difference between consumer payments and generator revenues.

As a function of K it reaches a maximum between the two extremes of no capacity and unlimited capacity:



#### Crossborder transmission capacity trading in practice



**Goal:** efficient allocation of cross-border transmission capacities in order to optimise social welfare.

**Explicit auction:** transmission rights are auctioned separately and independently from the electricity market.

- annual, monthly and daily auctions
- bilaterally or via exchange


**Implicit auction:** transmission rights and energy are coupled and traded simultaneously (i.e. buyers bid for electricity supplied by generators from the neighbouring market area). The price per area reflects both the cost of energy and congestion.

• via exchange

#### **Explicit** auction




In explicit auctions, traders sell/buy electricity and capacity separately.

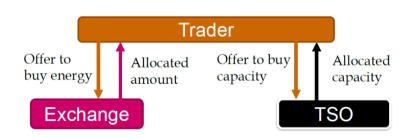

#### **Implicit auction**





In an implicit auction, the market clearing and use of interconnection capacity is determined **simultaneously** in an algorithm which **optimises overall social welfare**. In Europe for the day ahead market this algorithm is called EUPHEMIA.

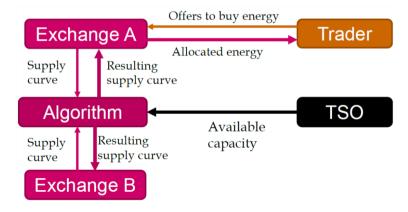

#### Trend from explicit to implicit auction












- Top left: day-ahead coupling in 2003.
- Top right: day-ahead coupling in 2007.
- Bottom left: day-ahead coupling in 2021 (borders in yellow not coupled).
- Bottom right: intraday coupling over time.

# Redispatch

#### The Problem: Congestion inside bidding zones



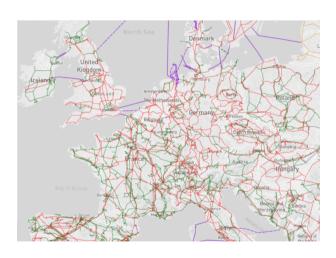



- The country-sized and regional bidding zones ignore congestion inside the bidding zones.
- The bidding zone is defined by assuming no congestion inside its borders.
- However, the resulting market dispatch can still lead to violations of transmission capacity inside the zone.
- Counter-measures: redispatch outside the market.

#### The problem is exacerbated by wind and solar




Renewables are not always located near demand centres, as in this example from Germany.





#### The problem






- This leads to overloaded lines in the middle of Germany, which cannot transport all the wind energy from North Germany to the load in South Germany
- It also overloads lines in neighbouring countries due to loop flows (unplanned physical flows 'according to least resistance' which do not correspond to traded flows)
- It also blocks imports and exports with neighbouring countries, e.g. Denmark

#### Scheduled market flows versus physical flows



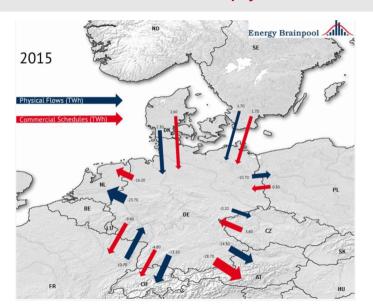

Power traded between zones ("scheduled flows", red) does not always correspond to what flows according to the network physics ("physical flows", blue). This leads to political tension as wind from Northern Germany flows to Southern Germany via Poland and the Czech Republic as a loop flow rather than flowing inside Germany as intended.

#### Solution 1: Redispatch after energy market clearing



These problems are **not visible** in the day-ahead electricity market, which treats the whole of Germany as a single bidding zone. It dispatches wind in North Germany as if there was no internal congestion...


To ensure that the physical limits of transmission are not exceeded, the network operator must 're-dispatch' power stations and curtail (Einspeisemanagement) renewables to restore order. This is costly (0.8 redispatch + 0.6 RE-compensation = 1.4 billion EUR in 2017 - although exceptional circumstances in 1st quarter) and results in lost  $CO_2$ -free generation (5.5 TWh curtailment of RE and CHP in 2017).

**International redispatch** is sometimes also required (Multilateral Remedial Actions = MRA).

Furthermore, there are **no market incentives** to reinforce the North-South grid, to locate more power stations in South Germany or to build storage / P2X in North Germany.


### Redispatch



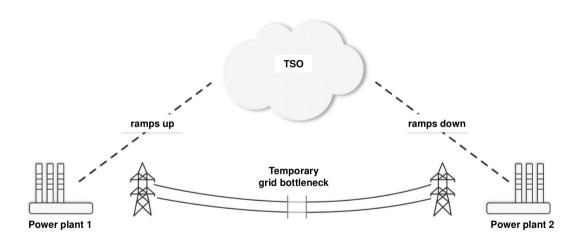

## Redispatch in Germany: Trend



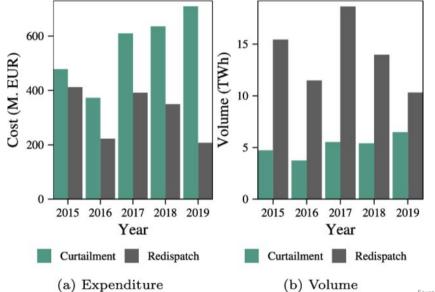

#### Redispatch 2.0



From October 2021 redispatch was reformed in Germany in NABEG 2.0. Before it was distinguished between redispatch (for conventional power stations) and curtailment (for renewables and CHP).

The goal of the new legislation is:

- To put conventionals and renewables on same footing (both can participate in redispatch)
- Also involve units attached to the distribution grid (units above 100 kW or those already that can be controlled)

## Solution 1b: Measures involving multiple bidding zones




Sometimes redispatch actions within the bidding zone are not sufficient.

Here there are two options (much rarer than redispatch):

- **Counter-trading**: Transmission system operators buy power in one bidding zone and sell in another on the power exchanges to reduce a bottleneck either on the border or inside the bidding zone.
- Multilateral Remedial Action (MRA): Post-market redispatch involving multiple bidding zones.

## Solution 2: Grid expansion within bidding zones



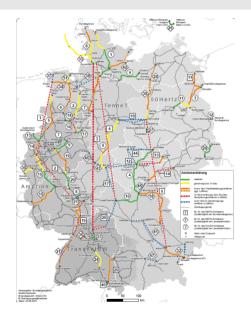

- Relieve congestion by expanding capacities inside the bidding zone
- Investment increases money TSOs can claim via network fee on consumers
- Regulator (Bundesnetzagentur) must approve the grid expansion plans

#### Solution 3: Smaller bidding zones to "see" congested boundaries






- In Scandinavia they have solved this by introducing smaller bidding zones
- Now congestion at the boundaries between zones is taken into account in the implicit auctions of the market
- This is also done in Italy (again, a long country), where prices for small consumers are uniformised for fairness

#### **Solution 4: Nodal pricing**






- The ultimate solution, as used in the US and other markets, is nodal pricing, which exposes all transmission congestion
- Considered too complex and subject to market power to be used in Europe, but this is questionable...
- Here we see clearly why many argue for a North-South German split

#### First step: Split Germany North-South





- Initial price difference could average up to 12 EUR/MWh
- Prices would converge with more network expansion
- Redispatch costs reduced by 39% in 2025, 58% in 2035 (assuming NEP 2030 transmission projects get built)
- Politically difficult, may require, like Italy, uniformised price on consumer side

#### Solution 1.5: Flow-based market coupling



Flow-based market coupling can be used in zonal markets to see precise individual line constraints, instead of "boxing" the feasible space like ATC/NTC schemes do.

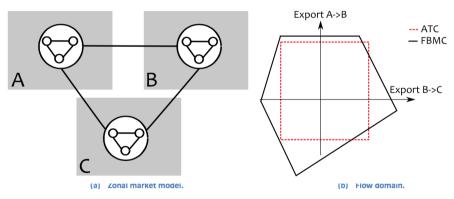


Figure 4. In the FMBC method, only one equivalent node per zone is considered, but all (critical) lines are taken into account.

In this simple grid, the zonal network consists of 3 nodes and 12 lines. The FBMC flow domain is larger than the ATC flow domain as the physical characteristics of the grid are better represented in the FBMC method.

#### Solution 1.5: Flow-based market coupling





- From May 2015 to early 2022 flow-based market coupling was only applied in Germany, France, Netherlands, Belgium and Luxembourg
- From mid-2022 it has been extended across northern 'Core' countries in continental Europe

# Balancing Power

#### **System services**



**System services** are provided by the Transmission System Operator to maintain the stability of the grid for electricity market transactions. They include:

- Frequency control
- Voltage control
- Black-start capacities for grid restoration after black-outs
- Compensation for transmission losses
- Cross-border interconnection management

#### General modes of provision:

- Compulsory
- Bilateral
- Tendering

#### Markets for frequency control power




Control power markets provide frequency control.

Frequency is determined by **balance of supply and demand**.

Target frequency in Europe: 50 Hz (in other parts of world, like US, it is 60 Hz)

Excessive demand  $\rightarrow$  frequency drops  $\rightarrow$  **positive** balancing energy is procured by TSO


Excessive generation  $\rightarrow$  frequency rises  $\rightarrow$  **negative** balancing energy is procured by TSO

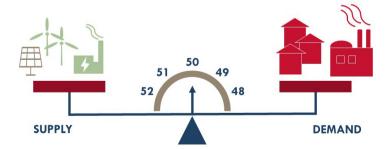

## Markets for frequency control power



Power is scheduled in Germany on a 15-minute basis. For deviations from the schedule, **positive** control power is needed for an excess of demand, **negative** for an excess of generation.

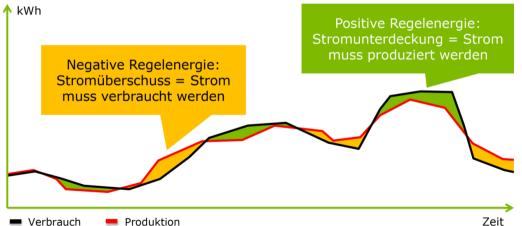


#### Different types of control power



Control power is distinguished by how fast it acts.


Old terminology: primary for fast-acting, through tertiary for slow-acting.

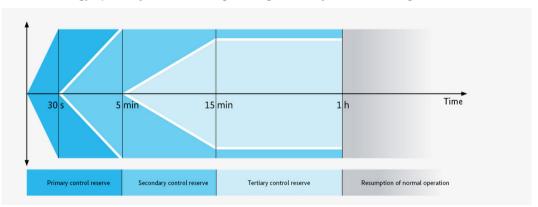

### Different types of control power




Example activation during frequency excursion. New terminology: FCR: Frequency Containment Reserve (primary), aFRR: automatic Frequency Restoration Reserve (secondary), **mFRR**: manual Frequency Restoration reserve (tertiary).

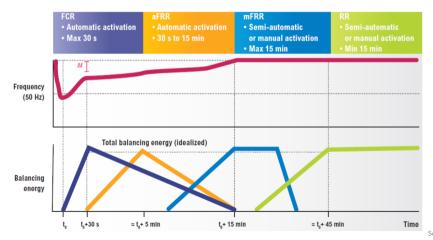

### Utilisation of control power



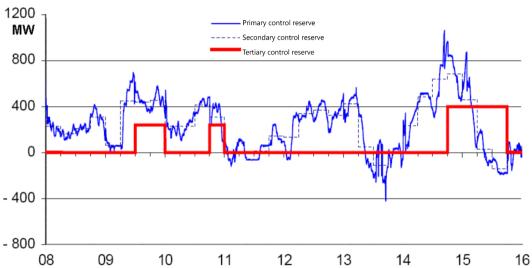

#### **European balancing markets**



#### European balancing target model has following goals:

- Effective competition
- Non-discrimination
- Transparency
- Integration

#### European platforms and projects under development:

- IGCC, International Grid Control Cooperation imbalance netting
- PICASSO, Platform for the International Coordination of Automated Frequency Restoration and Stable System Operation – aFRR
- MARI, Manually Activated Reserves Initiative mFRR
- TERRE, Trans-European Restoration Reserves Exchange RR


#### Markets for control power



TSOs procure balancing power from **Balance Service Providers (BSP)** in balancing markets. Energy cost is charged to balance group.

Balance Service Providers (BSP): generators, demand response, storage.

NB: Difference between system imbalance (global) and balance group imbalance (local).

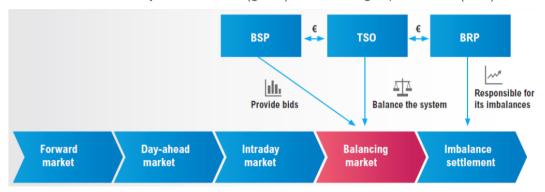

#### Markets for control power



Reserves are procured either via pay-as-clear (marginal pricing) or pay-as-bid auctions (you get paid what you bid). Only capacity is procured for FCR; for FRR both capacity and energy prices are procured in separate markets (since 2020). You don't have to be successful in the capacity market to bid in energy, but if you bid in capacity, you have to bid in energy.


	FCR (primary)	aFRR (secondary)	mFRR (tertiary / minute)				
activation	based on frequency	automatic by TSO	manual by TSO				
full power	within 30 seconds	within 5 minutes	within 15 minutes				
bids	symmetric	positive or negative	positive or negative				
min bid size	1 MW	5 MW	5 MW				
auctions	6*4 hour slices per day	6*4 hour slices per day	6*4 hour slices per day				
compensation	capacity only	capacity & energy	capacity & energy				
pay-as-	clear	bid (P), clear (E)	bid (P), clear (E)				

#### Control power pay-as-bid auction



Because there are few players and concerns about oligopoly, i.e. market power, some control power markets use **pay-as-bid**: you get paid what you bid rather than a uniform clearing price.


In theory, pay-as-bid should result in lower costs than pay-as-clear (since actors bid close to variable cost), but in practice they raise bids to anticipate the marginal bid. FCR moved to pay-as-clear in 2019, in Summer 2022 aFRR and mFRR energy auctions are also pay-as-clear.

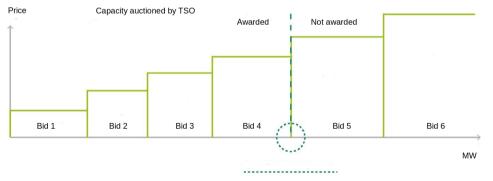

#### Control power pay-as-bid auction




Reducing entry barriers are in focus of market design.

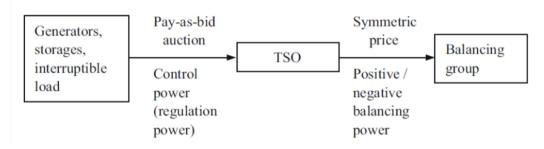

#### **Control power tendered quantities in Germany**




#### **Tendered Quantities of Control Reserve in Germany** / Average amount in MW per year

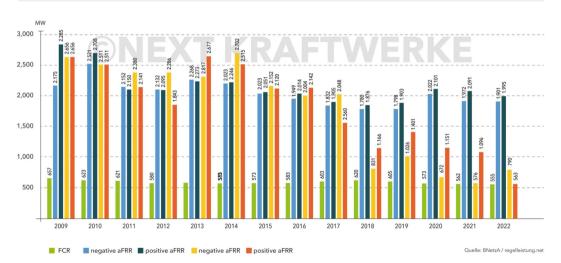

#### Cost allocation of control power



Distinguish between **capacity price** for availability and **energy price** for utilisation.

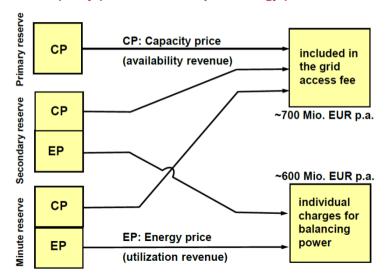

#### Capacity spending on control power



The total spent on capacity auctions (ignoring energy) has declined significantly.

#### Kosten der Vorhaltung von Regelenergie

in Mio. Euro



### System restoration after a black-out



- If there is a system-wide black-out, the grid operators must **black-start** the system.
- This involves restoring electricity in each region (see right) and then slowly reconnecting the black-started island systems.
- Most generators need electricity to start, so black-start capable plants are needed at the beginning, typically hydro plants or diesel plants next to a tank of fuel oil.
- Costs associated with black-start capability: investment, maintenance, regular tests, personnel and training.
- Move to introduce market procurement.



#### Example of Iberian peninsula restoration after April 2025 black-out



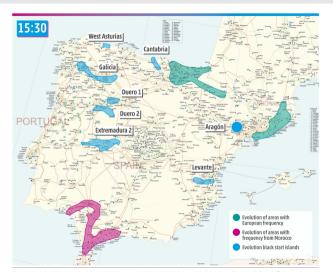


Figure 4-4: Evolution of the restoration in the transmission network and black-start islands through 15:30 (1,952 MW of load supplied) - Red Eléctrica

- On 28th April 2025 at around 1233 there was a complete blackout on the Iberian peninsula (Spain and Portugal).
- Inter-connectors to France and Morocco tripped.
- The system was gradually restored over 10 hours by forming black-start islands (blue) as well as taking power from France (green) and Morocco (red).

#### LinkedIn video of restoration




#### German distribution grid




Definition of **distribution grid** in Germany: everything below 220 kV. The distribution grid distributes electricity to and from the transmission grid, whereas the transmission grid transports it over long distances. Low voltage:  $\leq 1$  kV, middle voltage: 3-30 kV, high voltage: 110 kV. Ultra high voltage transmission: 220-380 kV.

**Germany's electricity distribution grid** (more than 1.7 million kilometres long)

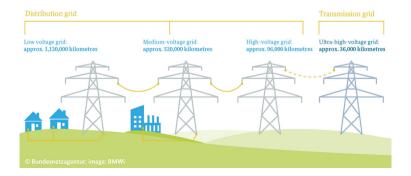

#### **Energy transition in distribution grids**



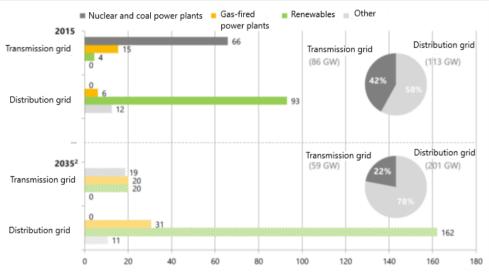


#### **Energy transition in distribution grids**



More complexity for the Distribution System Operator (DSO):

- Congestion management
- Voltage control
- Smart meters to enable both dynamic tariffs and network-oriented control of assets like heat pumps and electric vehicles
- Grid restoration after blackout
- (Frequency control only in isolated systems)



#### **Smart meters**




- Old analogue electricity meters could only cumulate the total consumption (e.g. yearly)
- Modern smart meters combine the ability to measure and store the (sub-)hourly consumption, enabling dynamic tariffs, but also allow communication through a gateway, e.g. to allow the grid operator to interrupt load
- German 2023 law requires all customers to have the option to install a smart meter with dynamic tariff from 2025 ("soweit technisch machbar und wirtschaftlich zumutbar")
- By 2032 all customers with demand > 6000 kWh/a (i.e. those with heat pumps or electric vehicles) are required to have one



## **Smart meter rollout in Germany**



Although  $\sim$  20% of Germany's 50 million metering locations are modern  $\Rightarrow$  measure hourly demand, in 2021 only 160,000 had smart meter gateway for communication.

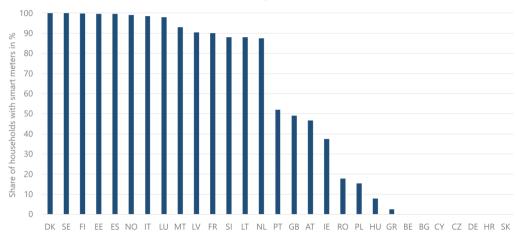

## Network Fees

#### **Grid** as monopoly



Grid operation is a **natural monopoly**, as network infrastructure is prohibitively costly to replicate.

As any monopoly, it is prone to eliminating newcomers (potential competition for affiliated generation/retail unit) by overcharging or denying technical feasibility.

Good **regulation** should guarantee:

- Non-discriminatory third-party access (i.e. of generators and consumers)
- Transparency
- Cost recovery (so network operator doesn't go bankrupt)
- Cost reflectiveness (clear connection between charges and actual costs)

### Composition of grid tariffs



67

Grid tariffs must cover the following expenses of grid operators:

- Operation and Maintenance (O&M)
- Grid extension
- Control power (capacity component)
- Feed-in management (Einsman)
- Redispatch
- Grid reserve (capacity held for redispatch in South)
- Capacity reserve (for peak capacity, cannot participate in energy market now or ever)
- Security reserve (coal/climate reserve)
- Reactive power
- Grid losses

• Other


#### Most network costs are at the distribution grid level



		2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
Stromabsatz	(TWh)	479	467	462	465	447	451	448	445	445	440	419	419	413
Gesamtaus- gaben		58,7	63,6	64,3	58,7	70,4	69,5	68,5	69,0	73,3	75,1	76,3	79,8	92,5
Staatlich in-														
duzierte		16,4	22,5	23,7	29,6	32,3	31,5	33,2	34,8	34,6	34,0	33,9	33,6	20,3
Elemente														
Stromsteu- ern		6,4	7,2	7,4	7,0	6,6	6,7	6,9	6,9	6,7	6,6	6,5	6,7	6,6
Konzessions- abgaben		2,1	2,2	2,1	2,1	2,0	2,1	2,0	2,0	2,0	2,0	1,9	1,9	1,9
EEG-Umlage		7,5	12,9	13,9	19,3	22,4	22,0	22,8	24,5	24,6	22,8	23,2	22,6	8,9
KWKG		0,4	0,2	0,3	0,4	0,5	0,6	1,3	1,3	1,1	1,0	0,8	0,9	1,3
Umlagen (§														
17F EnWG, §					0,8	0,8	0,1	0,2	0,0	0,2	1,6	1,5	1,4	1,5
18 AbLaV)	·													
Staatlich re-	Mrd													
gulierte	2	15,2	15,4	16,5	18,1	17,8	18,0	18,7	20,8	19,9	20,1	20,6	21,1	23,2
Elemente														
Netzentgelte														
Übertra-		2,2	2,2	2,6	3,0	3,1	3,5	3,8	5,3	5,7	4,9	4,9	4,9	5,3
gungsnetze														
Netzentgelte		13.0	13.2	13,9	15,1	14,7	14,5	14,9	15,5	14,2	15.2	15,7	16.2	17.9
Verteilnetze		13,0	13,2	13,3	13,1	14,7	14,5	14,5	13,3	14,2	13,2	13,7	10,2	17,5
Marktgetrie-														
bene		27,1	25,7	24,1	11,0	20,3	20,0	16,6	13,5	18,8	21,0	21,8	25,2	48,9
Elemente														
Marktwert		3.5	4.4	4.7	4.2	4.1	4.7	4.3	5.9	8.0	7.2	5.7	13.6	33.6
EEG-Strom		3,3	,	,,	,-	-1,2	٠,,	-1,5	5,5	0,0	,,_	٥,,	10,0	35,0
Erzeugung und Vertrieb		23,6	21,3	19,4	6,8	16,2	15,3	12,3	7,6	10,8	13,8	16,1	11,6	15,3

## Grid tariff regulation: Regulation approaches



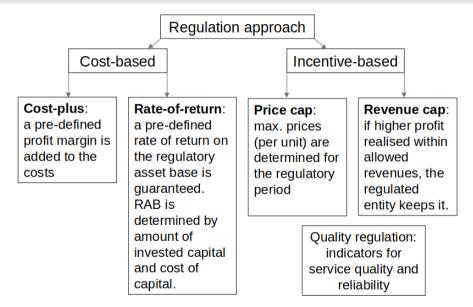

#### Incentive regulation in Germany



- 5-year regulatory period (current period 2019-2024)
- Revenue that TSO/DSO is allowed to earn is fixed for the regulatory period at a level.
- Revenue cap: total cost + depreciation + return on equity
- Investment costs into grid extension are allowed above cap.

#### Costs:

- permanently non-controllable
- temporarily non-controllable
- controllable
- volatile

**Efficiency benchmarking** - based on cost examination and structural data validation of individual TSO/DSO. The most efficient entity serves as benchmark.

#### Future of network fees in Germany



The energy transition changes the role of network fees.

- Network fees need to incentivise flexible demand rather than hindering it.
- ullet Can consider time-varying network fees, like the time-varying wholesale electricity price. Currently flexibility is often penalised; e.g. large industrial consumers ( $\sim$  20% of German demand) get a discount of up to 90% if they have a smooth consumption for at least 7000 hours a year.
- Unlike other countries where generation also pays, in Germany only loads pay network
  fees. Distribution grid fees depend on local costs, so consumers in eastern Germany are
  unfairly burdened with costs for renewable connection. Need redistribution! BNetzA is
  working on it.
- Since costs are very high, there is some discussion about the government paying to reduce the fees.


**Electricity Retail Markets** 

#### Retail competition



The ultimate rationale of liberalisation/restructuring of the electricity sector is the prospect of **lower prices** for electricity consumers achievable through **competition**.

The option for final customer to **switch supplier** creates a competitive pressure for market players along the electricity supply chain.



11/'05 7,0

Angaben in Prozent

11/'07 11,0 11/'06 8.0

Stand: 11/2023

#### Categories of suppliers in the German market



- Remnants of large vertically integrated utilities: E.ON, RWE, Vattenfall, EnBW
- Municipal utilities (Stadtwerke Potsdam/München, etc.)
- Retailers with mixed ownership structure
- Small independent retailers

Typically supplier has Balance Responsible Party (BRP) role.

Electricity retail markets are **regional**: distribution network level.

Default supplier (Grundversorger) is the designated supplier obliged to supply any customer in their supply area (in Germany: the entity supplying the largest number of grid connection points; in Berlin: Vattenfall).

Apart from the baseline contract, the default supplier can offer alternative tariffs.

#### **Categories of final customers**



- Residential
- Commercial
- Industrial

Household customers: up to 10,000 kWh yearly consumption

- residential & small commercial
- standard load profile (SLP) approximation

Non-household customers: all other

- commercial (> 10,000 kWh yearly consumption) & industrial
- registered load profile measurement (RLM): >100 GWh p.a.


#### Retail price composition: household & industry customers



#### Note the high fraction of regulated (Netzentgelte) and state-induced taxes and levies.

#### Strompreis für Haushalte


Durchschnittlicher Strompreis für einen Haushalt in ct/kWh, Jahresverbrauch 3.500 kWh Grundpreis anteilig enthalten, Tarifprodukte und Grundversorgungstarife inkl. Neukundentarife enthalten, nicht mengenewichtet



19% MwSt im Jahr 2020

\* EEG-Umlage entfällt ab 01.07.2022

#### Strompreis für die Industrie (inkl. Stromsteuer)



15.23

15,32

15.11

14.33

Stand: 11/2023

2015

2014

2013

2012

Ouelle: VEA, BDEW



<sup>\*</sup> EEG-Umlage entfällt ab 01.07.2022